



**COMPLIANCE TEST REPORT**

**RECEIVED**

**NOV 16 2018**

for

**AIR QUALITY DIVISION**

**TOTAL PARTICULATE MATTER (PM), FINE  
PARTICULATE MATTER (PM<sub>10/2.5</sub>) AND  
CONDENSABLE PARTICULATE EMISSIONS**

**UNIT 3**

**St. Clair Power Plant  
East China, Michigan**

**October 10-11, 2018**

**Prepared By  
Environmental Management & Resources  
Environmental Field Services Group  
DTE Corporate Services, LLC  
7940 Livernois H-136  
Detroit, MI 48210**



## EXECUTIVE SUMMARY

DTE Energy's Environmental Management and Resources (EM&R) Field Services Group performed particulate emissions testing on the exhaust of Unit 3 at the St. Clair Power Plant, located in China Township, Michigan. The testing was required by the Michigan Department of Environmental Quality (MDEQ) Michigan Renewable Operating Permit MI-ROP-B2796-2015b to document total filterable particulate matter (PM), PM<sub>10</sub> (particulate matter less than 10 microns diameter), PM<sub>2.5</sub> (particulate matter less than 2.5 microns diameter), and condensable particulate matter (CPM) stack emissions. The testing was conducted during the period of October 10-11, 2018.


A summary of the emission test results is shown below:

### Emissions Testing Summary St. Clair Unit 3 October 10-11, 2018

Source	Filterable PM (lbs/1000 lbs @ 50% EA) <sup>(1)</sup>	Primary PM <sub>10</sub> (lbs/MMBtu) <sup>(2)</sup>	Primary PM <sub>2.5</sub> (lbs/MMBtu) <sup>(2)</sup>	Condensable PM (lbs/MMBtu)
<b>Unit 3</b>	0.0004	0.0223	0.0222	0.0222

(1) Unit 3 Permit Limit 0.17 lb/1000lbs @ 50% EA

(2) Primary PM<sub>10/2.5</sub> is the sum of fractioned PM and condensables



## 1.0 INTRODUCTION

DTE Energy's Environmental Management and Resources (EM&R) Field Services Group performed particulate emissions testing on the exhaust of Unit 3 at the St. Clair Power Plant, located China Township, Michigan. The testing was required by the Michigan Department of Environmental Quality (MDEQ) Michigan Renewable Operating Permit MI-ROP-B2796-2015b to document total filterable particulate matter (PM), PM<sub>10</sub> (particulate matter less than 10 microns diameter), PM<sub>2.5</sub> (particulate matter less than 2.5 microns diameter), and condensable particulate matter (CPM) stack emissions while the unit was operating during normal boiler operating conditions. The testing was conducted during the period of October 10-11, 2018.

Testing was performed pursuant to Title 40, *Code of Federal Regulations*, Part 60, Appendix A (40 CFR §60 App. A), Methods 1, 3, 4, 5B, 201A and 202.

The fieldwork was performed in accordance with EPA Reference Methods and DTE Energy Intent to Test, which was approved in a letter by Mr. Thomas Gaslioli from the Michigan Department of Environmental Quality (MDEQ), dated August 27, 2018<sup>1</sup>. The following DTE Energy personnel participated in the testing program: Mr. Jason Logan, Environmental Specialist, Mr. Mark Westerberg, Senior Environmental Specialist, and Mr. Frank Kurta, Environmental Technician. Mr. Logan was the project leader. Mr. Joe Neruda, Senior Environmental Specialist at the plant provided process coordination for the testing program.

## 2.0 SOURCE DESCRIPTION

The St Clair Power Plant (SCPP) located at 4901 Pointe Drive in East China, Michigan, employs the use of five (5) coal-fired boilers (Units 1-3, 6, and 7). Units 1-3 each have Babcock and Wilcox boilers capable of producing 1,070,000 pounds per hour of steam. Unit 1 is equipped with General Electric turbine generators each with a nominally rated capability of 167 megawatts (MW). Units 2 and 3 have Allis Chalmers turbine generators each with a nominally rated capability of 170 MW.

Units 6 and 7 have Combustion Engineering boilers capable of producing 2,100,000 and 3,580,000 pounds of steam per hour respectively. The turbine generators on each unit were manufactured by Westinghouse and have a nominally rated capability of 325 and 500 megawatts respectively. Full load capability for Units 6 and 7 while firing coal only is approximately 315 MW and 470 MW respectively.

---

<sup>1</sup> MDEQ, Approval Letter, dated August 27, 2018. (Attached-Appendix A)



The air pollution control equipment on Units 1-3 consists of Wheelabrator Frye electrostatic precipitators on each unit that have design collection efficiencies of 99.6%. Each exhaust stack is 599 feet tall with an internal diameter of 13.3 feet. The air pollution control equipment on Unit 6 consists of Research Corporation electrostatic precipitators that have design collection efficiencies of 99.6%. The exhaust stack is 425 feet tall with an internal diameter of 19.0 feet. The air pollution control equipment on Unit 7 consists of an American Standard electrostatic precipitator that has design collection efficiency of 99.6%. The exhaust stack is 600 feet tall with an internal diameter of 16.0 feet

Testing occurred on Unit 3 at greater than 85% of normal full load capability while burning coal and oil.

### 3.0 SAMPLING AND ANALYTICAL PROCEDURES

DTE Energy obtained emissions measurements in accordance with procedures specified in the USEPA *Standards of Performance for New Stationary Sources* or listed as an approved "Other Test Method". The sampling and analytical methods used in the testing program are indicated in the table below:

Sampling Method	Parameter	Analysis
USEPA Methods 1-2	Exhaust Gas Flow Rates	Field data analysis and reduction
USEPA Method 3A	Oxygen & CO <sub>2</sub>	Instrumental Analyzer Method
USEPA Method 4	Moisture Content	Gravimetric Analysis
USEPA Method 5B	Filterable Particulate Matter (Non-Sulfuric Acid)	Gravimetric Analysis
USEPA Method 201A	PM <sub>10/2.5</sub>	Gravimetric Analysis
USEPA Method 202	Condensable Particulate Matter	Gravimetric Analysis



### **3.1 STACK GAS VELOCITY AND FLOWRATES (USEPA Methods 1-2)**

#### **3.1.1 Sampling Method**

Stack gas velocity traverses were conducted in accordance with the procedures outlined in USEPA Method 1, "Sample and Velocity Traverses for Stationary Sources," and Method 2, "Determination of Stack Gas Velocity and Volumetric Flowrate." Four (4) sampling ports were utilized, sampling at three (3) points per port for a total of twelve (12) sampling points. See Figure 1 for a diagram of the traverse/sampling points used.

A cyclonic flow check was performed during Unit 3's initial flow monitor certification RATA. Testing at the sampling location demonstrated that no cyclonic flow was present. No changes to the stack have occurred since the cyclonic flow check was performed. Additionally, a static pressure check was performed which confirmed that the null angle was 0°.

#### **3.1.2 Method 2 Sampling Equipment**

The EPA Method 2 sampling equipment consisted of a 0-10" incline manometer, calibrated S-type pitot tubes ( $C_p = 0.84$  &  $0.798$ ) and a type-K calibrated thermocouple.

### **3.2 OXYGEN AND CARBON DIOXIDE (USEPA Method 3A)**

#### **3.2.1 Sampling Method**


Stack gas Oxygen ( $O_2$ ) and Carbon Dioxide ( $CO_2$ ) emissions were evaluated using USEPA Method 3A, "Gas Analysis for Carbon Dioxide, Oxygen, Excess Air, and Dry Molecular Weight (Instrumental Analyzer Method)". The  $O_2 / CO_2$  analyzers utilize paramagnetic sensors.

#### **3.2.2 $O_2 / CO_2$ Sampling Train**

The Method 3A sampling system consisted of collecting an integrated dry gas sample in a Tedlar bag during each test. The Tedlar bag was then analyzed using a Servomex 1400  $O_2 / CO_2$  gas analyzer.

#### **3.2.3 Sampling Train Calibration**

The  $O_2 / CO_2$  analyzer was calibrated according to procedures outlined in USEPA Method 7E. Zero, span, and mid range calibration gases were introduced directly into the analyzer to verify the instruments linearity. The  $O_2 / CO_2$  concentrations were recorded on the field data sheets.



### 3.3 MOISTURE DETERMINATION (USEPA Method 4)

#### 3.3.1 *Sampling Method*

Determination of the moisture content of the exhaust gas was performed using the method described in USEPA Method 4, "Determination of Moisture Content in Stack Gases". The moisture was collected in glass impingers as a component of the PM sampling trains and the percentage of moisture was then derived from calculations outlined in USEPA Method 4.

### 3.4 PARTICULATE MATTER (USEPA Method 5B)

#### 3.4.1 *Filterable Particulate Sampling Method*

USEPA Method 5B, "Determination of Non-Sulfuric Acid Particulate Emissions from Stationary Sources" was used to measure the filterable (front-half) particulate emissions (see Figure 3 for a schematic of the sampling train). Triplicate, 60-minute test runs were conducted.

The Method 5B modular isokinetic stack sampling system consisted of the following:

- (1) PTFE coated stainless-steel button-hook nozzle
- (2) Heated glass-lined probe
- (3) Heated 3" glass filter holder with a quartz filter (maintained at a temperature of  $320 \pm 25$  °F)
- (4) Set of impingers for the collection of condensate for moisture determination
- (5) Length of sample line
- (6) Environmental Supply® control case equipped with a pump, dry gas meter, and calibrated orifice.

The quartz filters used in the sampling were initially baked for 3 hours at 320 °F, desiccated for 24 hours and weighed to a constant weight as described in Method 5B to obtain the initial tare weight.

After completion of the final leak test for each test run, the filter was recovered, and the probe, nozzle and the front half of the filter holder assembly were brushed and rinsed with acetone. The acetone rinses were collected in a pre-cleaned sample container. The container was labeled with the test number, test location, test date, and the level of liquid marked on the outside of the container. Immediately after recovery, the sample containers were placed in a cooler for storage.

At the laboratory, the acetone rinses were transferred to clean pre-weighed beakers, and evaporated to dryness at ambient temperature and pressure. The beakers and

RECEIVED

NOV 16 2018

AIR QUALITY DIVISION



filters were baked for 6 hours at 320 °F, desiccated for 24 hours and weighed to a constant weight (within 0.5 mg). The data sheets containing the initial and final weights on the filters and beakers can be found in Appendix C.

Collected field blanks consisted of a blank filter and acetone solution blank. The acetone blank was collected from the rinse bottle used in sample recovery. The blank filter and acetone were collected and analyzed following the same procedures used to recover and analyze the field samples. Field data sheets for the Method 5B sampling can be found in Appendix B.

#### **3.4.2 Quality Control and Assurance**

All sampling and analytical equipment was calibrated according to the guidelines referenced in EPA Method 5B. All Method 1-4, and 5B calibration data is located in Appendix D.

#### **3.4.3 Data Reduction**

The filterable PM emissions data collected during the testing was calculated and reported as lb/1000lbs @ 50% excess air for comparison to the permitted emission limit.

### **3.5 PM<sub>10</sub> / PM<sub>2.5</sub> and CONDENSIBLE PM (USEPA METHODS 201A/202)**


#### **3.5.1 PM<sub>10</sub> / PM<sub>2.5</sub> Sampling (Method 201A)**

USEPA "Method 201A, "Determination of PM<sub>10</sub> and PM<sub>2.5</sub> Emissions from Stationary Sources" was used to measure the PM<sub>10</sub>/PM<sub>2.5</sub> emissions on Unit 3 (see Figure 3 for a schematic of the sampling train). Triplicate, 120-minute test runs were conducted.

The Method 201A sampling train consisted of the following:

- (1) PM<sub>10</sub> Cyclone with nozzle followed by a PM<sub>2.5</sub> cyclone
- (2) 47 mm quartz filter capable of capturing 0.3um size particulate
- (3) Stainless steel probe with glass liner with attached s-type pitot tube and Type K thermocouple
- (4) Independent heated filter box with filter bypass
- (5) Teflon tubing to connect the filter bypass to the Method 202 train
- (6) Method 202 glassware
- (7) Method 5 umbilical and meter box.

Prior to performing each test run the entire sampling train was leak checked. At the completion of each test the cyclone was removed and a final leak was performed at the inlet of the probe. After the cyclone cooled, it was disassembled and two



sections of the cyclone were rinsed with acetone and the filter was placed into a Petri dish which was sealed. The collected fractions were as follows:

- (1) PM between 10 and 2.5 microns – back half of PM<sub>10</sub> cyclone and front half of PM<sub>2.5</sub> Cyclone
- (2) PM <2.5 microns – Back half of PM<sub>2.5</sub> cyclone and 47mm filter.

The acetone rinses were collected into pre-cleaned sample containers. The containers were labeled with the test number, sample fraction, test location, test date, and the level of liquid marked on the outside of the container. Immediately after recovery, the sample containers were placed in a cooler for storage.

At the laboratory, the acetone rinses were transferred to clean pre-weighed beakers, and evaporated to dryness at ambient temperature and pressure. The beakers and filters were then desiccated for 24 hours and weighed to a constant weight. The data sheets containing the initial and final weights on the filters and beakers can be found in Appendix C.

Collected field blanks consisted of a blank filter and acetone solution blank. The acetone blank was collected from the rinse bottle used in sample recovery. The blank filter and acetone were collected and analyzed following the same procedures used to recover and analyze the field samples.

### **3.5.2 Condensable Particulate Sampling Method (Method 202)**

USEPA Method 202, “Dry Impinger method for Determining Condensable Particulate Emissions from Stationary Sources” was used to measure the condensable particulate matter (CPM). This method includes procedures for measuring both organic and inorganic CPM. The Method 202 samples were collected in conjunction with the Method 201A samples.

The Method 202 sampling configuration (Figure 3 – after the Method 201A cyclone assembly,) consisted of the following:

- (1) Filter bypass connected to the glass probe liner
- (2) Teflon tubing to connect the filter bypass to the Method 202 glassware
- (3) Method 23 type condenser (capable of cooling the stack gas to less than 85 °F)
- (4) Condensate dropout impinger (dry) without the bubbler tube
- (5) Modified Greenburg-Smith impinger (dry) with no taper as a backup impinger
- (6) 3” glass filter holder with a PTFE filter (maintained at a temperature  $65^{\circ}\text{F} \leq X \leq 85^{\circ}\text{F}$ )



- (7) Modified Greenburg-Smith impinger containing 100 millimeters (ml) of distilled de-ionized (DDI) water
- (8) Modified Greenburg-Smith impinger containing approximately 300 grams of silica gel desiccant.


The condensate dropout impinger and backup impinger were placed in an insulated box with water and maintained so that the gas stream temperature at the exit of the condensable filter holder was between 65 and 85 °F. The water and silica gel impingers were placed in an ice water bath to maintain the exit gas temperature from the silica gel impinger below 68°F.

All Method 202 glassware was pre-cleaned prior to testing with soap and water, and rinsed using tap water, distilled de-ionized (DDI) water, acetone, and finally, hexane. After cleaning, the glassware was baked at 300 °C for 6 hours.

After the post-test leak check was completed, the sample probe and independent heated filter box were detached from the Method 202 condenser and impinger train. The Method 202 impinger train was then carefully disassembled. The liquid volume of each impinger was measured (by weight) and recorded on the field data sheet. The silica gel was re-weighed, and any increase was recorded on the field data sheets. Moisture from the condensate dropout impinger was added to the second impinger. The Method 202 impinger train was purged with ultra-high purity compressed nitrogen at 14 liters per minute for 60 minutes. During the purge the condenser recirculation pump was operated and the first two impingers were heated/cooled to maintain the gas temperature exiting the CPM filter between 65 and 85 °F.

Contents from the dropout impinger and the impinger prior to the CPM filter were collected into a pre-cleaned sample container. The glass probe liner, filter bypass assembly, Teflon tubing between the heated box and glassware, condenser, impingers and front-half of the CPM filter holder were rinsed with DDI water and the rinses added to the sample container. The glass probe liner, filter bypass assembly, Teflon tubing between the heated box and glassware, condenser, impingers and front-half of the CPM filter holder were then rinsed with acetone followed by two rinses with hexane. The acetone and hexane rinses were collected into a pre-cleaned sample container. The CPM filter was recovered and placed into a labeled container. All containers were labeled with the test number, test location, test date, and the level of liquid marked on the outside of the container. Immediately after recovery, the sample containers were placed in a cooler for storage.

Collected blanks consisted of a field recovery blank, acetone rinse blank, a DDI water rinse blank, and a hexane rinse blank taken directly from the bottles used during



recovery of the samples. A proof blank was not required as the glassware was baked prior to use in the field.

Analysis of the Method 202 samples and blanks were conducted by Maxxam Analytics of Mississauga, Ontario. All analysis followed the procedures listed in Method 202. A complete laboratory report can be found in Appendix C.

Field data sheets for the Method 201A/Method 202 sampling can be found in Appendix B.

### **3.5.3 Quality Control and Assurance**

All sampling and analytical equipment was calibrated according to the guidelines referenced in EPA Methods 201A/202.

### **3.5.4 Data Reduction**

PM<sub>10/2.5</sub> sampling was performed utilizing Environmental Supply Company software. Emission rates were calculated utilizing this software as well. Particulate matter collected during the emissions testing is reported as pounds per thousand pounds exhaust gas at 50% excess air (lbs/1,000 lbs @ 50% EA), pounds per hour (lb/hr) and pounds per million British thermal unit (lbs/MMBtu).

## **4.0 OPERATING PARAMETERS**

The test program included the collection of boiler load and stack CEMs monitoring during each test run. Parameters recorded included gross Megawatts (MW), CO<sub>2</sub>, and CEMs PM.


Electrostatic Precipitator data was also collected including total power, sparks per minute, primary amps, primary voltage, secondary amps, secondary voltage, spark rate, and firing angle.

Coal samples were collected during sampling and subject to proximate and ultimate analysis.

Operational data and results of the fuel analysis can be referred to in Appendix F.

## **5.0 DISCUSSION OF RESULTS**

Tables 1 and 2 present the Particulate Emission testing results from Unit 3. Particulate emissions are presented in grain per dry standard cubic foot (gr/DSCF), pounds per hour (lbs/hr) pounds per 1000 pounds @ 50% excess air (lbs/1000lbs @ 50% excess air), and pounds per million British thermal unit (lb/MMBtu). Additional test data presented for each test includes the Unit load in gross megawatts (GMW), stack temperature in degrees Fahrenheit (°F), stack gas velocity in feet per minute (ft/min), and stack gas flow rate in actual cubic feet per minute (ACFM), standard cubic feet per minute (SCFM) and dry standard cubic





feet per minute (DSCFM). The average filterable PM emissions from Unit 3 were 0.004 lbs/1000lbs @ 50% excess air which is less than the permit limit of 0.17 lbs/1000lbs excess air.

The average Primary PM<sub>10</sub>, Primary PM<sub>2.5</sub>, and Condensable PM emissions were 0.0223, 0.0222, and 0.0222 lbs/MMBtu, respectively.

**6.0 CERTIFICATION STATEMENT**

"I certify that I believe the information provided in this document is true, accurate, and complete. Results of testing are based on the good faith application of sound professional judgment, using techniques, factors, or standards approved by the Local, State, or Federal Governing body, or generally accepted in the trade."

  
\_\_\_\_\_  
Mr. Jason Logan, QSTI

This report prepared by:   
\_\_\_\_\_  
Mr. Jason Logan, QSTI  
Environmental Specialist, Field Services  
Environmental Management and Resources  
DTE Energy Corporate Services, LLC



**Table No. 1**  
**PARTICULATE EMISSION TESTING SUMMARY**  
**St. Clair Power Plant - Unit 3**  
**October 10-11, 2018**

**Unit 3 - Total Filterable PM**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates			PM Emissions		
						(ACFM)	(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/1000lbs @ 50% EA) <sup>(1)</sup>
PM-1	11-Oct-18	8:07-9:14	165.1	271	5,537	773,106	538,054	495,220	0.0003	1.20	0.0006
PM-2	11-Oct-18	9:45-10:53	165.1	273	5,378	750,862	521,385	479,750	0.0005	0.65	0.0003
PM-3	11-Oct-18	11:22-12:29	165.4	275	5,480	765,135	529,730	489,118	0.0006	0.26	0.0001
<b>Average:</b>			<b>165.2</b>	<b>273</b>	<b>5,465</b>	<b>763,034</b>	<b>529,723</b>	<b>488,029</b>	<b>0.0005</b>	<b>0.70</b>	<b>0.0004</b>

(1) Permit Limit = 0.17 lbs/1000 lbs @ 50% excess air

**Unit 3 - PM10 Fraction**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates		PM10 Fraction Emissions		
						(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/MMBtu)
CPM-1	10-Oct-18	7:36-9:46	163.3	283	5,201	501,325	462,652	0.0000	0.14	0.0001
CPM-2	10-Oct-18	10:27-12:42	163.5	287	5,287	507,047	465,869	0.0000	0.14	0.0001
CPM-3	10-Oct-18	13:20-15:28	164.1	291	5,210	498,905	449,376	0.0000	0.00	0.0000
<b>Average:</b>			<b>163.6</b>	<b>287</b>	<b>5,233</b>	<b>502,426</b>	<b>459,299</b>	<b>0.0000</b>	<b>0.09</b>	<b>0.0001</b>

**Unit 3 - PM2.5 Fraction**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates		PM2.5 Fraction Emissions		
						(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/MMBtu)
CPM-1	10-Oct-18	7:36-9:46	163.3	283	5,201	501,325	462,652	0.0000	0.00	0.0000
CPM-2	10-Oct-18	10:27-12:42	163.5	287	5,287	507,047	465,869	0.0000	0.00	0.0000
CPM-3	10-Oct-18	13:20-15:28	164.1	291	5,210	498,905	449,376	0.0000	0.00	0.0000
<b>Average:</b>			<b>163.6</b>	<b>287</b>	<b>5,233</b>	<b>502,426</b>	<b>459,299</b>	<b>0.0000</b>	<b>0.00</b>	<b>0.0000</b>

**Unit 3 - Condensables Fraction**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates		Condensible PM Fraction Emissions		
						(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/MMBtu)
CPM-1	10-Oct-18	7:36-9:46	163.3	283	5,201	501,325	462,652	0.0059	23.54	0.0163
CPM-2	10-Oct-18	10:27-12:42	163.5	287	5,287	507,047	465,869	0.0080	32.00	0.0220
CPM-3	10-Oct-18	13:20-15:28	164.1	291	5,210	498,905	449,376	0.0105	40.27	0.0284
<b>Average:</b>			<b>163.6</b>	<b>287</b>	<b>5,233</b>	<b>502,426</b>	<b>459,299</b>	<b>0.0081</b>	<b>31.94</b>	<b>0.0222</b>



**Table No. 2**  
**PARTICULATE EMISSION TESTING SUMMARY**  
**St. Clair Power Plant - Unit 3**  
**October 10-11, 2018**

**Unit 3 - Primary PM10**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates		Primary PM10 Emissions		
						(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/MMBtu)
CPM-1	10-Oct-18	7:36-9:46	163.3	283	5,201	501,325	462,652	0.0059	23.68	0.0164
CPM-2	10-Oct-18	10:27-12:42	163.5	287	5,287	507,047	465,869	0.0080	32.14	0.0221
CPM-3	10-Oct-18	13:20-15:28	<u>164.1</u>	<u>291</u>	<u>5,210</u>	<u>498,905</u>	<u>449,376</u>	<u>0.0105</u>	<u>40.27</u>	<u>0.0284</u>
<i>Average:</i>			<b>163.6</b>	<b>287</b>	<b>5,233</b>	<b>502,426</b>	<b>459,299</b>	<b>0.0081</b>	<b>32.03</b>	<b>0.0223</b>

**Unit 3 - Primary PM2.5**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Velocity (ft/min)	Exhaust Gas Flowrates		Primary PM2.5 Emissions		
						(SCFM)	(DSCFM)	(grains/dscf)	(lbs/hr)	(lbs/MMBtu)
CPM-1	10-Oct-18	7:36-9:46	163.3	283	5,201	501,325	462,652	0.0059	23.54	0.0163
CPM-2	10-Oct-18	10:27-12:42	163.5	287	5,287	507,047	465,869	0.0080	32.00	0.0220
CPM-3	10-Oct-18	13:20-15:28	<u>164.1</u>	<u>291</u>	<u>5,210</u>	<u>498,905</u>	<u>449,376</u>	<u>0.0105</u>	<u>40.27</u>	<u>0.0284</u>
<i>Average:</i>			<b>163.6</b>	<b>287</b>	<b>5,233</b>	<b>502,426</b>	<b>459,299</b>	<b>0.0081</b>	<b>31.94</b>	<b>0.0222</b>



Figure 1 – Sampling Location & Traverse Points  
St Clair Power Plant – Units 1-3  
Oct 10-11, 2018

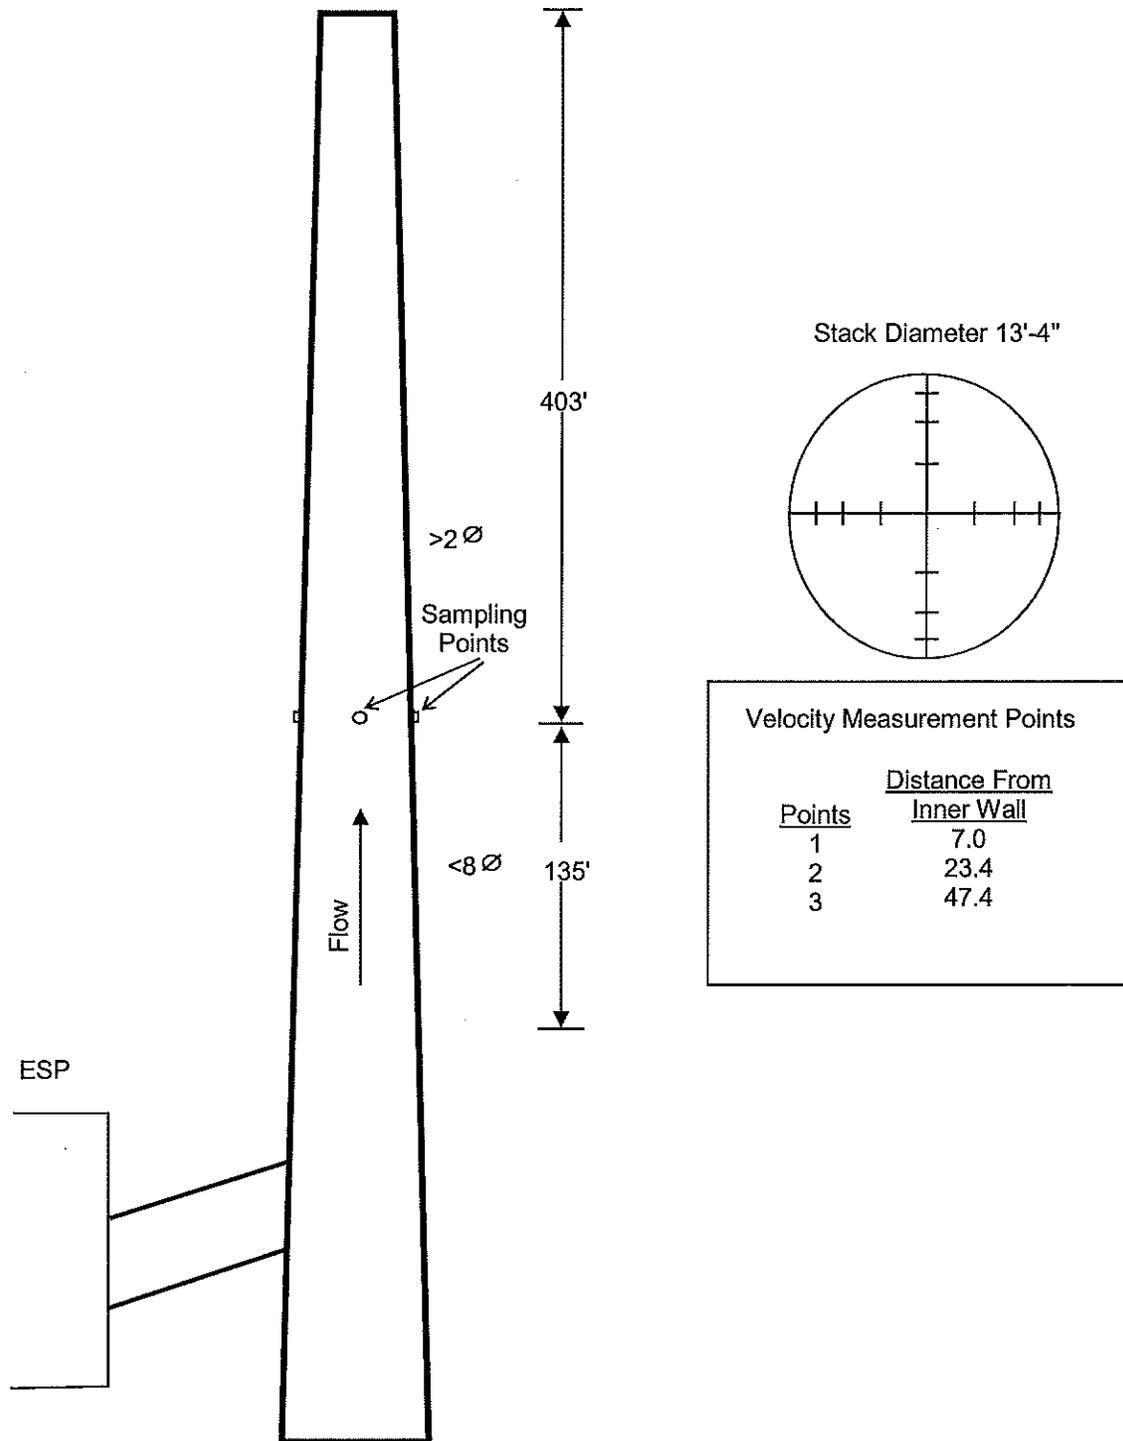




Figure 2 - EPA Methods 201A/202  
St Clair Power Plant – Unit 3  
Oct 10-11, 2018

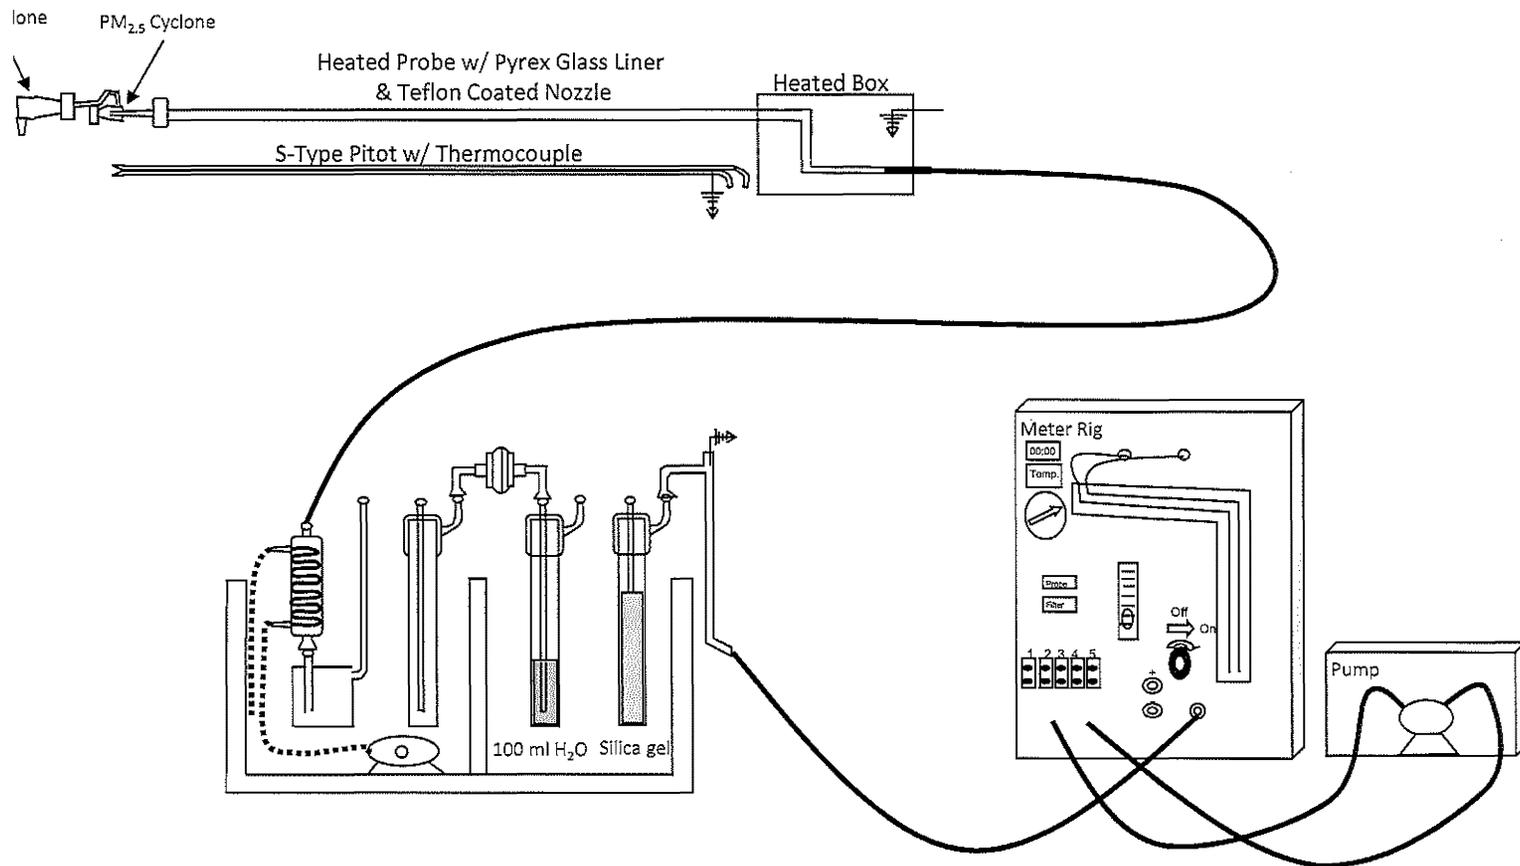




Figure 3– EPA Method 5B  
St Clair Power Plant – Unit 3  
Oct 10-11, 2018

