

# COMPLIANCE TEST REPORT

for

## PARTICULATE MATTER (PM) EMISSIONS

UNITS 1, 3 & 4 – FGD Stack

Monroe Power Plant  
Monroe, Michigan


July 8-10, 2014

**RECEIVED**  
SEP 09 2014  
AIR QUALITY DIV.

**DTE Energy**



Prepared By  
Environmental Management & Resources  
Environmental Field Services Group  
DTE Corporate Services, LLC  
7940 Livernois H-136  
Detroit, MI 48210



**RECEIVED**  
 SEP 09 2014  
 AIR QUALITY DIV.

**EXECUTIVE SUMMARY**


DTE Energy's Environmental Management and Resources (EMR) Field Services Group performed quarterly particulate emissions testing on Units 1, 3 & 4 FGD exhaust stacks located at the Monroe Power Plant, in Monroe, Michigan. The testing is required by the Michigan Department of Environmental Quality (MDEQ) Permit to Install #27-13 to document filterable Particulate Matter (PM) emissions during normal operating conditions on a quarterly basis. The testing for the 3rd quarter of 2014 was conducted on July 8-10, 2014.

A summary of the emission test results are shown below:

**Emissions Testing Summary  
 Units 1, 3 & 4 FGD Stack  
 Monroe Power Plant  
 July 8-10, 2014**

Source	Load (GMW)	PM <sup>(1)</sup> (lb/MMBtu)
Unit 1 (7/8/14)	777.7	0.014
Unit 3 (7/9/14)	709.6	0.013
Unit 4 (7/10/14)	709.7	0.009
Permit Limit		<b>0.011</b>

(1)= Total Filterable Particulate



## 1.0 INTRODUCTION

DTE Energy's Environmental Management and Resources (EMR) Field Services Group performed quarterly particulate emissions testing on Units 1, 3 & 4 FGD exhaust stacks located at the Monroe Power Plant (MONPP), in Monroe, Michigan. The testing is required by the Michigan Department of Environmental Quality (MDEQ) Permit to Install #27-13 to document filterable Particulate Matter (PM) emissions from the FGD Stack during normal operating conditions on a quarterly basis. The testing for the 3rd quarter of 2014 was conducted on July 8-10, 2014.

Testing was performed pursuant to Title 40, *Code of Federal Regulations*, Part 60, Appendix A (40 CFR §60 App. A), Methods 1-5, and 9.

The fieldwork was performed in accordance with EPA Reference Methods and EMR's Intent to Test<sup>1</sup>, which was approved in a letter by Mr. Tom Gasloli from the Michigan Department of Environmental Quality (MDEQ), dated October 14, 2010. The following EMR Field Services personnel participated in the testing program: Mr. Mark Grigereit, Senior Specialist, Mr. Fred Meinecke, Senior Environmental Technician, and Mr. Alex Casabuena, Summer Student. Mr. Grigereit was the project leader. Ms. Kelly Johnson, Environmental Engineer, with EMR, provided process coordination for the testing program. Mr. Brian Carley with the Air Quality Division of the Michigan Department of Environmental Quality (MDEQ) observed portions of the testing.

## 2.0 SOURCE DESCRIPTION

The Monroe Power Plant is a DTE Energy facility located at 3500 E. Front Street in Monroe, Michigan. The plant has four (4) coal-fired electric generating units, referred to as Units 1, 2, 3, and 4. These units were placed in service between 1971 and 1974, and have a total electric generating capacity of 3,135 megawatts (gross). The boiler (Babcock & Wilcox) for each unit is a similar supercritical pressure, pulverized coal-fired cell burner boiler. Units 1-4 exhaust into dedicated, separate stacks.

Units 1 and 4 have General Electric turbine generators, each having a current capability of 817 gross megawatts (GMW). Units 2 and 3 have Westinghouse turbine generators, each having a current capability of 823 GMW.

---

<sup>1</sup> MDEQ, Test Plan, Submitted July 17, 2011. (Attached-Appendix A)

<sup>2</sup> MDEQ, Approval Letter. (Attached-Appendix A)



The boiler exhausts are each equipped with Research Cottrell electrostatic precipitators (ESPs), with particulate removal efficiencies of 99.6%. There is a sulfur trioxide flue gas conditioning system on each unit that is only used on an “as needed basis” to lower the resistivity of the fly ash for better collection by the ESPs. None of the four units is equipped with sulfuric acid mist control equipment.

Units 1, 3, and 4 each have Selective Catalytic Reduction (SCR) systems to control 90% of the NO<sub>x</sub> emissions prior to their respective ESP's.

Units 1, 3 and 4 each have wet Flue Gas Desulfurization (FGD) Scrubbers to control sulfur dioxide (SO<sub>2</sub>), and other acid gases. The typical coal blend for each unit is a 65% low-sulfur western (LSW) / 35% mid-sulfur eastern (MSE). During the emissions testing the coal blend was approximately 65%LSW/35%MSE for Units 3 and 4, and 55%LSW/44%MSE for Unit 1. Units 1, 3 & 4 were operated at normal, full load conditions (>700 GMW).

The boilers at Monroe Power Plant employ the use of continuous soot-blowing, therefore a separate soot blowing PM test was not necessary.

The exhaust stacks for Units 1, 3 and 4 are each 580 feet tall with an internal diameter of 28 feet. See Figure 1 for a diagram of Units 1, 3, and 4's sampling locations and stack dimensions.

### 3.0 SAMPLING AND ANALYTICAL PROCEDURES

DTE Energy obtained emissions measurements in accordance with procedures specified in the USEPA *Standards of Performance for New Stationary Sources*. The sampling and analytical methods used in the testing program are indicated in the table below

Sampling Method	Parameter	Analysis
USEPA Methods 1-2	Exhaust Gas Flow Rates	Field data analysis and reduction
USEPA Method 3A	Oxygen & CO <sub>2</sub>	Instrumental Analyzer Method
USEPA Method 4	Moisture Content	Field data analysis and reduction
USEPA Method 5	Particulate Matter	Gravimetric Analysis



### **3.1 STACK GAS VELOCITY AND FLOWRATES (USEPA Methods 1-2)**

#### **3.1.1 Sampling Method**

Stack gas velocity traverses were conducted in accordance with the procedures outlined in USEPA Method 1, "Sample and Velocity Traverses for Stationary Sources," and Method 2, "Determination of Stack Gas Velocity and Volumetric Flowrate." Four (4) sampling ports were utilized on each unit's exhaust stack, sampling at three (3) points per port for a total of twelve (12) points. Velocity traverses were conducted simultaneously with the particulate sampling. See Figure 2 for a diagram of the traverse/sampling points used.

Cyclonic flow checks were performed on the Units 1, 3 & 4 stacks during the initial flow monitor certification RATAs. Testing at the sampling location demonstrated that no cyclonic flow was present at either location. No changes to the stacks have occurred since the cyclonic flow checks were performed.

#### **3.1.2 Method 2 Sampling Equipment**

The EPA Method 2 sampling equipment consisted of a 0-10" incline manometer, S-type Pitot tube ( $C_p = 0.84$ ) and a Type-K calibrated thermocouple.

### **3.2 OXYGEN & CARBON DIOXIDE (USEPA Method 3A)**

#### **3.2.1 Sampling Method**

Oxygen ( $O_2$ ) and carbon dioxide ( $CO_2$ ) emissions were evaluated using USEPA Method 3A, "Gas Analysis for Carbon Dioxide, Oxygen, Excess Air, and Dry Molecular Weight (Instrumental Analyzer Method)". The analyzers utilize paramagnetic sensors.

#### **3.2.2 $O_2/CO_2$ Sampling Train**

The EPA Method 3A sampling system (Figure 3) consisted of the following:

- (1) Teflon™ sampling line (collecting gas sample from the meter rig exhaust)
- (2) Universal® gas conditioner with particulate filter
- (3) Teflon™ connecting line
- (4) Servomax 1400  $O_2/CO_2$  gas analyzer
- (5) Appropriate USEPA Protocol 1 calibration gases
- (6) Data Acquisition System

#### **3.2.3 Sampling Train Calibration**

The  $O_2$  and  $CO_2$  analyzers were calibrated according to procedures outlined in USEPA Methods 3A. Zero, span, and mid range calibration gases were introduced directly



into the analyzer to verify the instruments linearity, prior to sampling, and again at the completion of each test run.

### **3.3 MOISTURE DETERMINATION (USEPA Method 4)**

#### **3.3.1 *Sampling Method***

Determination of the moisture content of the exhaust gas was performed using USEPA Method 4, "Determination of Moisture Content in Stack Gases". The moisture was collected in the Method 5 glass impingers, and the percentage of water was then derived from calculations outlined in USEPA Method 4.

### **3.4 PARTICULATE MATTER (USEPA Method 5)**

#### **3.4.1 *Filterable Particulate Sampling Method***


USEPA Method 5, "Determination of Particulate Emissions from Stationary Sources" was used to measure the filterable (front-half) particulate emissions (see Figure 4 for a schematic of the sampling train). Triplicate, 60-minute test runs were conducted.

The Method 5 modular isokinetic stack sampling system consisted of the following:

- (1) Teflon coated stainless-steel button-hook nozzle
- (2) Heated glass-lined probe
- (3) Heated 3" glass filter holder with a glass fiber filter (maintained at a temperature of  $248 \pm 25$  °F)
- (4) Set of impingers for the collection of condensate for moisture determination
- (5) Length of sample line
- (6) Environmental Supply<sup>®</sup> control case equipped with a pump, dry gas meter, and calibrated orifice.

The filters used in the sampling were initially desiccated for 24 hours and weighed to a constant weight, as described in Method 5, to obtain the initial tare weight.

After completion of the final leak test for each test run, the filter was recovered, and the probe, nozzle and the front half of the filter holder assembly were brushed and rinsed with acetone. The acetone rinses were collected in a pre-cleaned sample container. The container was labeled with the test number, test location, and test date. The level of liquid was marked on the outside of the container. Immediately after recovery, the sample containers were stored for transport.



At the laboratory the acetone rinses were transferred to clean pre-weighed beakers and evaporated to dryness at ambient temperature and pressure. The beakers and filters were desiccated for 24 hours and weighed to a constant weight (within 0.5 mg). The data sheets containing the initial and final weights on the filters and beakers are located in Appendix C.

Collected field blanks consisted of a blank filter and acetone solution blank. The acetone blank was collected from the rinse bottle used in sample recovery. The blank filter and acetone were collected and analyzed following the same procedures used to recover and analyze the field samples.

Field data sheets for the Method 5 sampling are located in Appendix B.

### **3.4.2 Quality Control and Assurance**

All sampling and analytical equipment was calibrated according to the guidelines referenced in EPA Method 5. All Method 1-4, and 5 calibration data is located in Appendix D.

### **3.4.3 Data Reduction**

The filterable PM emissions data collected during the testing was calculated and reported as lb/MMBtu.

## **4.0 OPERATING PARAMETERS**

The test program included the collection of CEMs emission data, electrostatic precipitator data, flue gas desulfurization system data, selective catalytic reduction system data, and sulfur trioxide conditioning system data during each PM emissions test. Operational data collected during the testing is presented in Appendix E.

During each day of emissions sampling, a representative coal sample was collected from the unit and analyzed for ultimate and proximate analysis, including % Sulfur, % Ash, and heat content. The results of the coal analysis was used to calculate an Fd value for each day of testing and used in the lb/MMBtu calculations (Appendix C).

## **5.0 DISCUSSION OF RESULTS**

Table 1 presents the Unit 1 filterable particulate emission testing results. Filterable particulate emissions are presented in pounds per million British thermal units (lbs/MMBtu). The Unit 1 filterable PM emissions during the testing averaged 0.014 lbs/MMBtu. The average filterable PM emissions exceeded the permit limit of 0.011 lbs/MMBtu.



Table 2 presents the Unit 3 filterable particulate emission testing results. Filterable particulate emissions are presented in pounds per million British thermal units (lbs/MMBtu). The Unit 3 filterable PM emissions during the testing averaged 0.013 lbs/MMBtu. The average filterable PM emissions exceeded the permit limit of 0.011 lbs/MMBtu.

Table 3 presents the Unit 4 filterable particulate emission testing results. Filterable particulate emissions are presented in pounds per million British thermal units (lbs/MMBtu). The Unit 4 filterable PM emissions during the testing averaged 0.009 lbs/MMBtu. The average filterable PM emissions are less than the permit limit of 0.011 lbs/MMBtu.

The auxiliary test data presented in the results table for each test includes the unit load in gross megawatts (GMW), stack temperature in degrees Fahrenheit (°F), stack gas moisture in percent (%), stack gas velocity in feet per minute (ft/min), and stack gas flow rate in actual cubic feet per minute (ACFM), standard cubic feet per minute (SCFM) and dry standard cubic feet per minute (DSCFM).




**6.0 CERTIFICATION STATEMENT**

"I certify that I believe the information provided in this document is true, accurate, and complete. Results of testing are based on the good faith application of sound professional judgment, using techniques, factors, or standards approved by the Local, State, or Federal Governing body, or generally accepted in the trade."

Thom Snyder for:  
Mark Grigereit, QSTI

This report prepared by: Thom Snyder for:  
Mr. Mark Grigereit, QSTI  
Senior Environmental Specialist, Field Services Group  
Environmental Management and Resources  
DTE Energy


This report reviewed by: Thomas Durham  
Mr. Thomas Durham  
Manager, Field Services Group  
Environmental Management and Resources  
DTE Energy



**TABLE NO. 1**  
**FILTERABLE PARTICULATE EMISSION TESTING RESULTS**  
**Monroe Power Plant - Unit 1**  
**July 8, 2014**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Moisture (%)	Stack Velocity (ft/min)	Exhaust Gas Flowrates			Filterable PM Emissions (lbs/MMBtu) <sup>(1)</sup>
							(ACFM)	(SCFM)	(DSCFM)	
PM-1	8-Jul-14	7:00-8:09	724.5	125.8	16.9	3,599	2,216,252	1,919,311	1,595,099	0.015
PM-2		8:28-9:36	801.0	126.8	16.8	3,894	2,397,867	2,073,053	1,724,729	0.014
PM-3		9:55-11:04	<u>807.5</u>	<u>126.8</u>	<u>16.6</u>	<u>3,941</u>	<u>2,426,666</u>	<u>2,097,951</u>	<u>1,750,225</u>	<u>0.012</u>
<i>Average:</i>			<i>777.7</i>	<i>126.5</i>	<i>16.8</i>	<i>3,811</i>	<i>2,346,928</i>	<i>2,030,105</i>	<i>1,690,018</i>	<i>0.014</i>

(1) Permit Limit = 0.011 lb/MMBtu



**TABLE NO. 2**  
**FILTERABLE PARTICULATE EMISSION TESTING RESULTS**  
**Monroe Power Plant - Unit 3**  
**July 9, 2014**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Moisture (%)	Stack Velocity (ft/min)	Exhaust Gas Flowrates			Filterable PM Emissions (lbs/MMBtu) <sup>(1)</sup>
							(ACFM)	(SCFM)	(DSCFM)	
PM-1	9-Jul-14	7:30-8:42	709.5	123.3	14.5	3,480	2,142,667	1,873,368	1,601,774	0.013
PM-2		8:57-10:14	709.3	124.3	14.4	3,454	2,126,666	1,856,462	1,589,790	0.013
PM-3		10:23-11:32	<u>709.9</u>	<u>123.2</u>	<u>15.0</u>	<u>3,469</u>	<u>2,135,942</u>	<u>1,868,022</u>	<u>1,587,515</u>	<u>0.012</u>
<i>Average:</i>			<i>709.6</i>	<i>123.6</i>	<i>14.6</i>	<i>3,468</i>	<i>2,135,092</i>	<i>1,865,951</i>	<i>1,593,026</i>	<i>0.013</i>

(1) Permit Limit = 0.011 lb/MMBtu

**RECEIVED**  
 SEP 09 2014  
 AIR QUALITY DIV.




**TABLE NO. 3**  
**FILTERABLE PARTICULATE EMISSION TESTING RESULTS**  
**Monroe Power Plant - Unit 4**  
**July 10, 2014**

Test	Test Date	Test Time	Unit Load (GMW)	Stack Temperature (°F)	Stack Moisture (%)	Stack Velocity (ft/min)	Exhaust Gas Flowrates			Filterable PM Emissions (lbs/MMBtu) <sup>(1)</sup>
							(ACFM)	(SCFM)	(DSCFM)	
PM-1	10-Jul-14	6:45-7:53	709.5	123.1	15.0	3,496	2,152,707	1,894,822	1,611,494	0.010
PM-2		8:07-9:15	709.8	124.0	15.0	3,621	2,229,791	1,959,590	1,666,672	0.009
PM-3		9:34-10:43	<u>709.9</u>	<u>124.6</u>	<u>15.7</u>	<u>3,720</u>	<u>2,290,902</u>	<u>2,011,287</u>	<u>1,695,464</u>	<u>0.010</u>
<i>Average:</i>			<i>709.7</i>	<i>123.9</i>	<i>15.2</i>	<i>3,612</i>	<i>2,224,467</i>	<i>1,955,233</i>	<i>1,657,877</i>	<i>0.010</i>

(1) Permit Limit = 0.011 lb/MMBtu



Figure 1 – Sampling Location  
Monroe Power Plant – Units 1, 3, & 4  
July 8-10, 2014

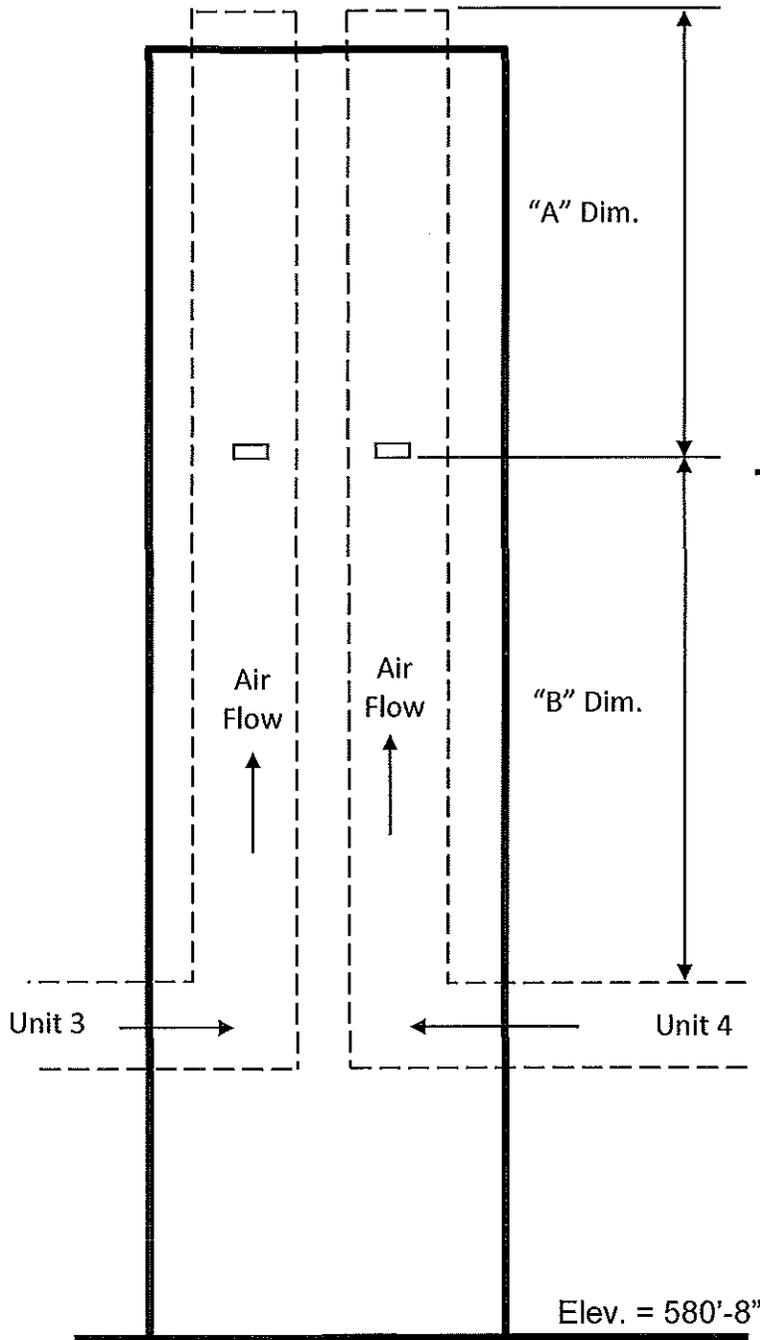


Details

"A" Dim = Upstream Distance  
"A" Dim = 201.6'  
"B" Dim = Downstream Distance  
"B" Dim = 233.8'  
Dia. @ Sample Location = 28'-0"



Figure 2 – Sampling Points  
Monroe Power Plant – Units 1, 3, & 4  
July 8-10, 2014

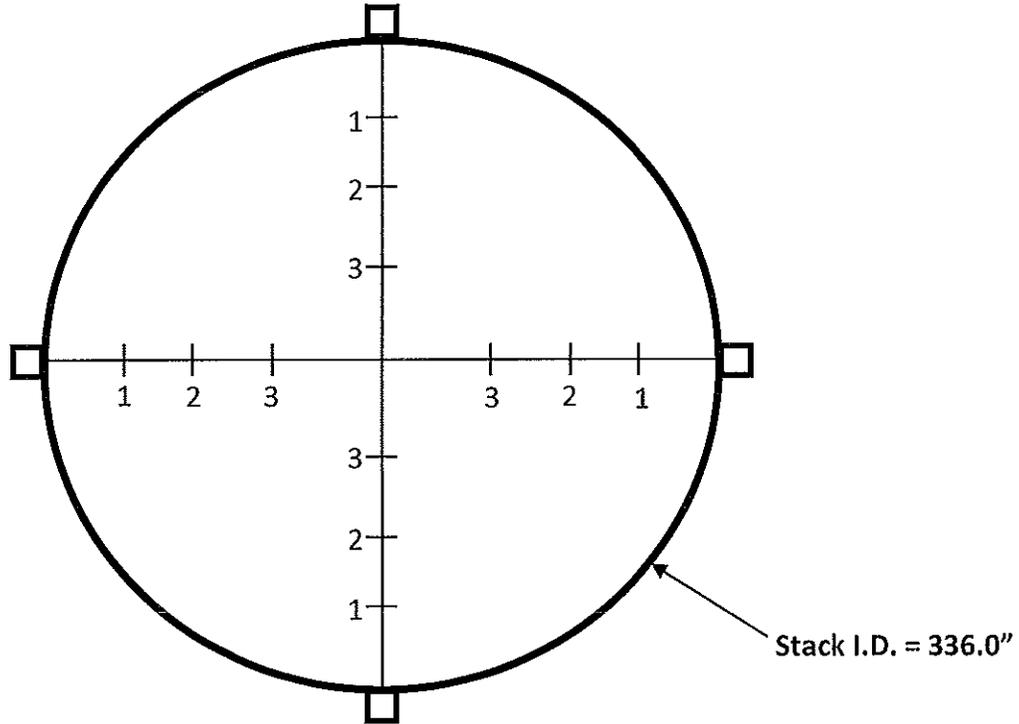


VELOCITY / PM MEASUREMENT  
POINTS

Point	Distance from Inside Wall
1	14.78"
2	49.06"
3	99.46"



Figure 3 – EPA Method 3A  
Monroe Power Plant – Units 1, 3, & 4  
July 8-10, 2014

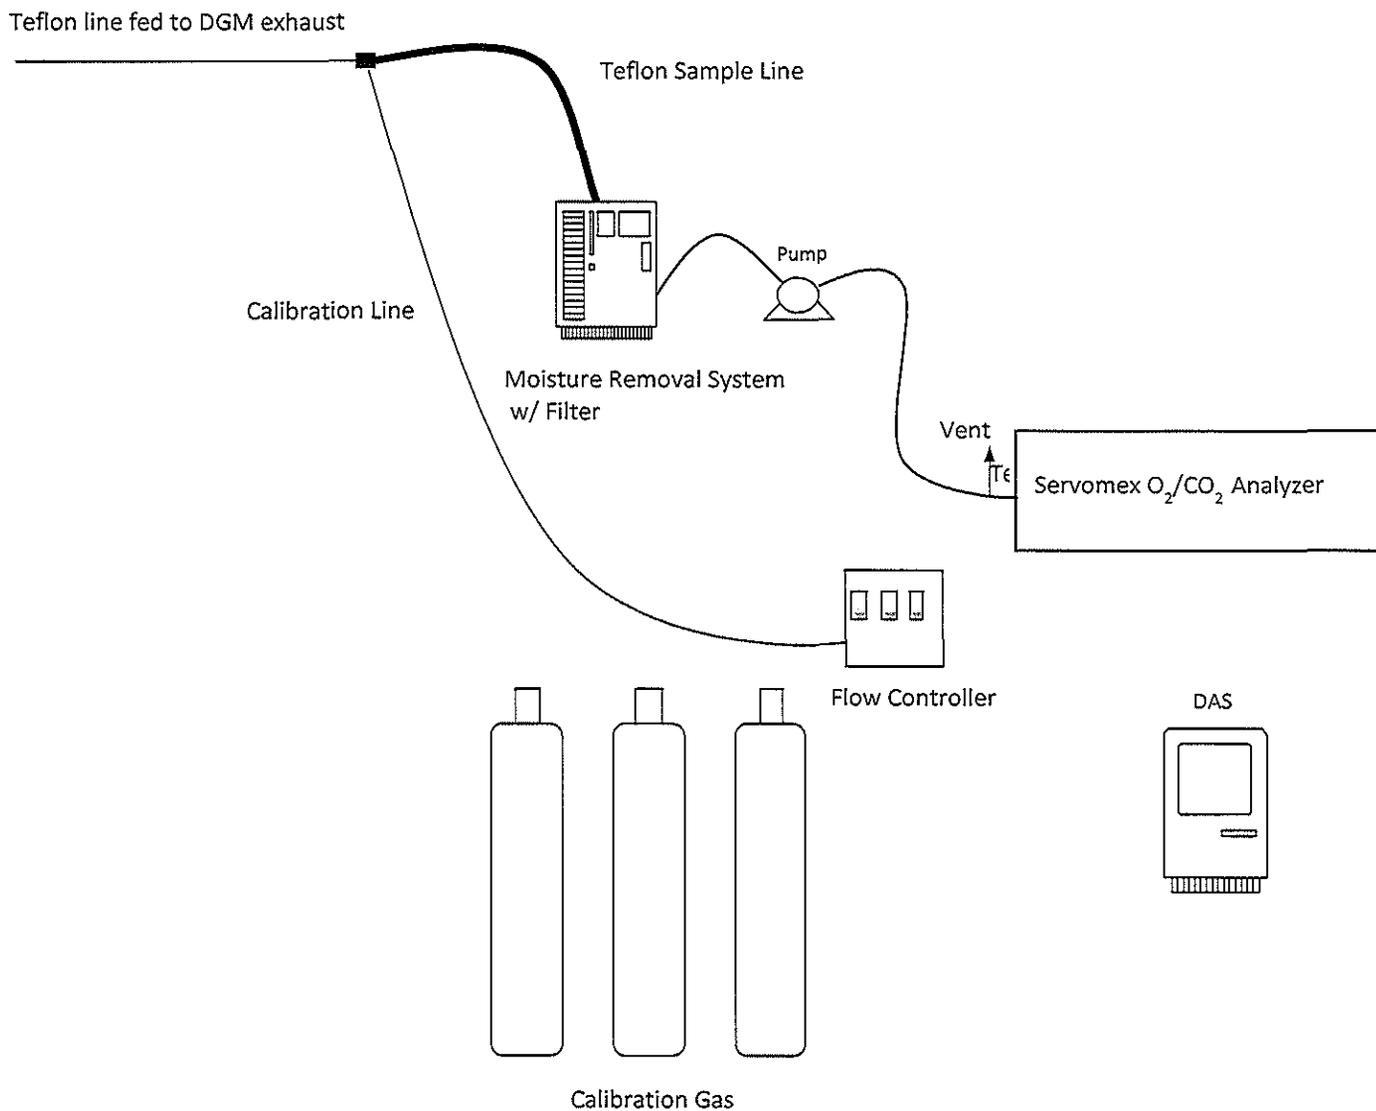




Figure 4 – EPA Method 5  
Monroe Power Plant – Units 1, 3, & 4  
July 8-10, 2014

