




2700 Wills St.  
Marysville, MI 48040  
(877) 365-2893

N6944  
KL

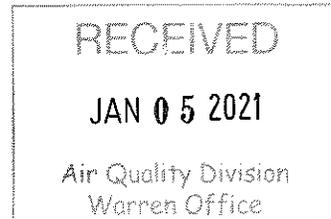

Posted  
1/8/2021

Jan 4, 2021

Ms. Kaitlyn Leffert  
MQED-Air Quality Division  
SE Michigan District  
27700 Donald Court  
Warren, MI 48092-2793


**RE: Resolution of VN 12-06-2020**

Dear Ms. Leffert:

Pregis LLC has conducted a thorough investigation as to what caused our Violation on Dec 6 through Dec 7, 2020. What was discovered is that 3 of our fresh air intakes had been shut off. This had been done because of the plant being shut down for a 2 day inventory and cost savings. After the plant was reopened for production the fresh air intake were not turned back on. The Pregis facility ROP CEM was set up to perform nominally with 3 of our 4 fresh air intakes running while maintaining negative pressure. With no fresh air being brought into the facility, the concentration level of the VOCs was higher than the calculated for the plant when operating. We have modified our MAP to help insure that this type of event will not happen again in the future.

Please feel free to contact me if you have any questions.

Sincerely,

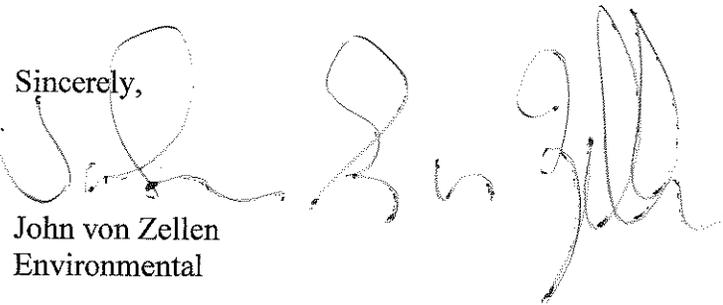  
John von Zellen  
Environmental