



September 2, 2021

District Supervisor
Air Quality Division
Michigan Department of Environment, Great Lakes, & Energy
Cadillac Place
3058 W. Grand Boulevard Suite 2-300
Detroit, MI 48202

Re: Quarterly Test Report for Hydrogen Chloride (HCl) on the exhaust of EG-09 Boiler No. 9A at DTE Electric Trenton Channel Power Plant (SRN: B2811) for compliance with MATS emission limits in 40 CFR Part 63.

Attached, please find one (1) copy of Compliance Test Report for the Quarterly Hydrogen Chloride (HCl) emissions testing conducted on the exhaust of EG-09 Boiler No. 9A at Trenton Channel Power Plant on July 13, 2021 in Trenton, Michigan. The testing was required by the Mercury and Air Toxics Standard (MATS) (40 CFR Part 63, Subpart UUUUU).

HCl testing is required each quarter. This satisfies the obligation for the 2nd Quarter of 2021. During the testing, the boiler was operated at a load that was representative of site specific normal operations.

If you have any questions concerning this test report, please contact me via email at Jason.Logan@dteenergy.com

Sincerely,
DTE ENERGY CORPORATE SERVICES, LLC


Jason Logan, QSTI
Environmental Specialist, Ecology, Monitoring, and Remediation
Environmental Management & Safety (EM&S)
DTE Energy Corporate Services, LLC

Enc: Compliance Test Report – TCPP Unit 9 (1 copy)

Cc: Karen Kajiya-Mills, EGLE (with enclosure)

RECEIVED
SEP 03 2021
AIR QUALITY DIV.

CONTENTS

<u>Section</u>	<u>Page</u>
1.0 INTRODUCTION	1
2.0 SOURCE DESCRIPTION	1
3.0 SAMPLING AND ANALYTICAL PROCEDURES	2
3.1 MOISTURE DETERMINATION (USEPA METHOD 4)	2
3.1.1 Sampling Method	2
3.2 HYDROGEN CHLORIDE (USEPA METHOD 26A)	2
3.2.1 HCl Sampling Method	2
3.2.2 Quality Control and Assurance	3
3.2.3 Data Reduction	3
4.0 OPERATING PARAMETERS	4
5.0 DISCUSSION OF RESULTS	4
6.0 CERTIFICATION STATEMENT	5

RESULTS TABLES

Table No. 1: HCl Emissions Testing Summary – EU-BOILER_9A

FIGURES

- 1 Sampling Location – EU-BOILER_9A
- 2 USEPA Method 26A Sampling Train

APPENDICES

- A Test Plan and Approval Letter
- B Field Sampling Data
- C Process Operational Data
- D Example Calculations
- E Analytical Data
- F Calibration Data



EXECUTIVE SUMMARY

DTE Energy's Environmental Management and Safety (EM&S) Ecology, Monitoring, and Remediation Group performed 2nd Quarter – 2021 Hydrogen Chloride (HCl) emissions testing on the exhaust of EU-BOILER_9A at the Trenton Channel Power Plant, located in Trenton, Michigan. Testing is required by 40 CFR Part 63, Subpart UUUUU (Mercury and Air Toxics Standards - MATS) to document quarterly HCl stack emissions. Testing was conducted on July 13, 2021 after the Unit returned from outage.

A summary of the emission test results is shown below:

Emissions Testing Summary Trenton Channel Power Plant EU-BOILER_9A

Source	Date	Load (GMW)	HCl (lbs/MmBtu) ⁽¹⁾
EU-BOILER_9A	7-13-21	315	0.0010

(1) MATS Limit 0.0020 lbs/MMBtu



1.0 INTRODUCTION

DTE Energy's Environmental Management and Safety (EM&S) Ecology, Monitoring, and Remediation Group performed 2nd Quarter – 2021 Hydrogen Chloride (HCl) emissions testing on the exhaust of EU-BOILER_9A at the Trenton Channel Power Plant, located in Trenton, Michigan. The testing was required by the 40 CFR Part 63, Subpart UUUUU (Mercury and Air Toxics Standards - MATS) to document quarterly HCl stack emissions. The testing was conducted on July 13, 2021 after the Unit returned from outage.

The fieldwork was performed in accordance with EPA Reference Methods and DTE Energy Intent to Test¹, which was approved in a letter by Mrs. Regina Angellotti from the Michigan Department of Environment, Great Lakes, and Energy (EGLE), dated November 10, 2020². The following DTE Energy personnel participated in the testing program: Mr. Jason Logan, Environmental Specialist, and Mr. Mark Westerberg, Senior Environmental Specialist. Mr. Logan was the project leader. Mr. Austin Sash, Environmental Engineer, provided process coordination for the testing program.

2.0 SOURCE DESCRIPTION

The Trenton Channel Power Plant (TCPP) located at 4695 W. Jefferson Avenue, Trenton, Michigan, employs the use of one coal-fired boiler. Boiler 9A is a Combustion Engineering Boiler that has a nameplate capacity of 520 gross megawatts (GMW) and produces 3,915 klb/hr of steam at full load. See Figure 1 for a diagram of the units' sampling locations and stack dimensions.

Particulate emissions from Boiler 9A are controlled via American Standard electrostatic precipitators.

Boiler 9A is equipped with a Dry Sorbent Injection (DSI) and Activated Carbon Injection (ACI) air quality control system. The DSI system is used to control acid gas, PM, PM10, PM2.5, and NOx emissions from each unit. Trona is received at the plant where inline mills further refine the Trona. The ACI system is used to control Mercury emissions from each unit.

Testing was performed on EU-BOILER_9A while operating at normal load conditions, per Subpart UUUUU.

¹ Test Plan, Submitted October 2, 2020. (Attached-Appendix A)

² Approval Letter, dated November 10, 2020. (Attached-Appendix A)

3.0 SAMPLING AND ANALYTICAL PROCEDURES

DTE Energy obtained emissions measurements in accordance with procedures specified in the USEPA *Standards of Performance for New Stationary Sources* or listed as an approved "Other Test Method". The sampling and analytical methods used in the testing program are indicated in the table below:

Sampling Method	Parameter	Analysis
USEPA Method 4	Moisture Content	Field data analysis and reduction
USEPA Method 26A	Hydrogen Chloride	Ion Chromatography
USEPA Method 19	Emission Rate Calculations	Stoichiometric Calculations

3.1 MOISTURE DETERMINATION (USEPA Method 4)

3.1.1 Sampling Method

Determination of the moisture content of the exhaust gas was performed using the method described in USEPA Method 4, "Determination of Moisture Content in Stack Gases". The exhaust gas condensate was collected in glass impingers and the percentage of moisture was derived from calculations outlined in USEPA Method 4 as a component of the HCl sampling train.

3.2 HYDROGEN CHLORIDE (USEPA Method 26A)

3.2.1 HCl Sampling Method

USEPA Method 26A, "Determination of Hydrogen Halide and Halogen Emissions" was used to measure the Hydrochloric Acid (HCl) emissions (see Figure 2 for a schematic of the sampling train). Method 26A uses impingers containing 0.1N H₂SO₄ to capture the HCl. Triplicate, 60-minute test runs were conducted. Method 26A sampling was performed as a single point sample per Method 26 procedures.

The Method 26A stack sampling system (Figure 2) consisted of the following:

- (1) Heated glass-lined probe (Maintained 248 °F < T < 273 °F)
- (2) Heated 3" glass filter holder with a PTFE filter (maintained at a temperature of 248 °F < T < 273 °F)
- (3) Set of impingers for the collection HCl and condensate for moisture determination (Impingers containing 0.1N H₂SO₄)
- (4) Length of sample line

- (5) Environmental Supply[®] control case equipped with a pump, dry gas meter, and calibrated orifice.

After completion of each run, a leak test was conducted. All the impingers were measured for moisture gain. The contents of impingers 1 and 2 were collected in a designated sample container. Impingers 1 and 2, the back half of the filter holder, the Z-fitting connecting the filter holder to the first impinger, and the U-tube between the first and second impingers were then rinsed with DI water and collected in the same sample container. Each container was labeled with the test number, test location, test date, and the level of liquid marked on the outside of the container. Immediately after recovery, the sample containers were placed in a cooler for storage.

Collected field blanks consisted of a 0.1N H₂SO₄ solution blank. 200ml of 0.1N H₂SO₄ was collected and diluted with DI water, from the same bottle used in sample recovery, to the liquid level of the three test runs. The blank was collected and analyzed following the same procedures used to recover and analyze the field samples.

Analysis of the Method 26A samples and blanks were conducted by Enthalpy Analytical. All analysis followed the procedures listed in USEPA Method 26A. A complete laboratory report is in Appendix E.

Field data sheets for the Method 26A sampling are in Appendix B.

3.2.2 Quality Control and Assurance

All sampling and analytical equipment was calibrated per the guidelines referenced in EPA Method 5 and 26A.

3.2.3 Data Reduction

HCl emissions data collected during the testing were calculated and reported as parts per million (ppm) and pounds per million Btu (lb/MMBtu). A coal sample was collected on the day of testing and was analyzed by DTE's internal laboratory for proximate and ultimate fuel analysis. An Fc factor was calculated based on this data. Equation 19-7 in Method 19 was used in conjunction with the Fc factor and CO₂ from the CEMS to calculate lb/MMbtu.

Analysis of the Method 26A samples and blanks were conducted by Enthalpy Analytical. All analyses followed the procedures listed in USEPA Method 26A. A complete laboratory report is in Appendix E.

Field data sheets for the Method 26A sampling are in Appendix B.



4.0 OPERATING PARAMETERS

The test program included the collection of boiler load and stack emissions CEMs data during each test run. Parameters recorded included gross Megawatts (GMW), CO₂ (%), steamload (klb/hr), and HCl (ppm). Additionally, dry sorbent injection rates (DSI) and activated carbon injection rates (ACI), in pounds per hour (lb/hr), are reported. Operational Data collected during the testing is presented in Appendix C.

HCl emissions testing was performed at normal operating load and representative of site specific normal operating conditions according to 40 CFR part 63.10007.


5.0 DISCUSSION OF RESULTS

Table 1 presents the HCl emission testing results from EU-BOILER_9A. HCl emissions are presented in parts per million on a wet basis (ppm_w) and pounds per million BTU (lbs/MMBtu). The EU-BOILER_9A HCl emissions during the testing demonstrated an average HCl concentration of 0.57 ppm and 0.0010 lb/MMBtu. The average EU-BOILER_9A HCl emissions were within the Subpart UUUUU limit of 0.0020 lb/MMBtu.

The auxiliary test data presented in the results table for each test includes the unit load in gross megawatts (GMW), DSI Injection rate (lb/hr), ACI injection rate (lb/hr), and CO₂ concentration (%_{wet}).

6.0 CERTIFICATION STATEMENT

"I certify that I believe the information provided in this document is true, accurate, and complete. Results of testing are based on the good faith application of sound professional judgment, using techniques, factors, or standards approved by the Local, State, or Federal Governing body, or generally accepted in the trade."



Mr. Jason Logan, QSTI

This report prepared by: 

Mr. Jason Logan, QSTI
Environmental Specialist, Ecology, Monitoring, and Remediation
Environmental Management and Safety
DTE Energy Corporate Services, LLC

DTE

RESULTS TABLES



TABLE NO. 1
HYDROGEN CHLORIDE EMISSIONS TESTING RESULTS
Trenton Channel Power Plant - EU-BOILER_9A
July 13, 2021


Test	Test Date	Test Time (EST)	Unit Load (GMW)	DSI Injection Rate (lb/hr)	ACI Injection Rate (lb/hr)	CO ₂ Concentration (% _{wet})	HCl Concentration (ppmv _{wet})	HCl Emissions (lbs/MMBtu) ⁽¹⁾
HCl-1	13-Jul-21	6:48-7:48	315	65	148	10.4	0.54	0.0009
HCl-2		7:57-8:57	315	75	148	10.4	0.59	0.0010
HCl-3		9:04-10:04	<u>315</u>	<u>54</u>	<u>148</u>	<u>10.4</u>	<u>0.59</u>	<u>0.0010</u>
<i>Average:</i>			<i>315</i>	<i>65</i>	<i>148</i>	<i>10.4</i>	<i>0.57</i>	<i>0.0010</i>

(1) MATS Limit = 0.002 lb/MMBtu

DTE

FIGURES


Figure 1 – Sampling Location
Trenton Channel Power Plant – Boiler 9A

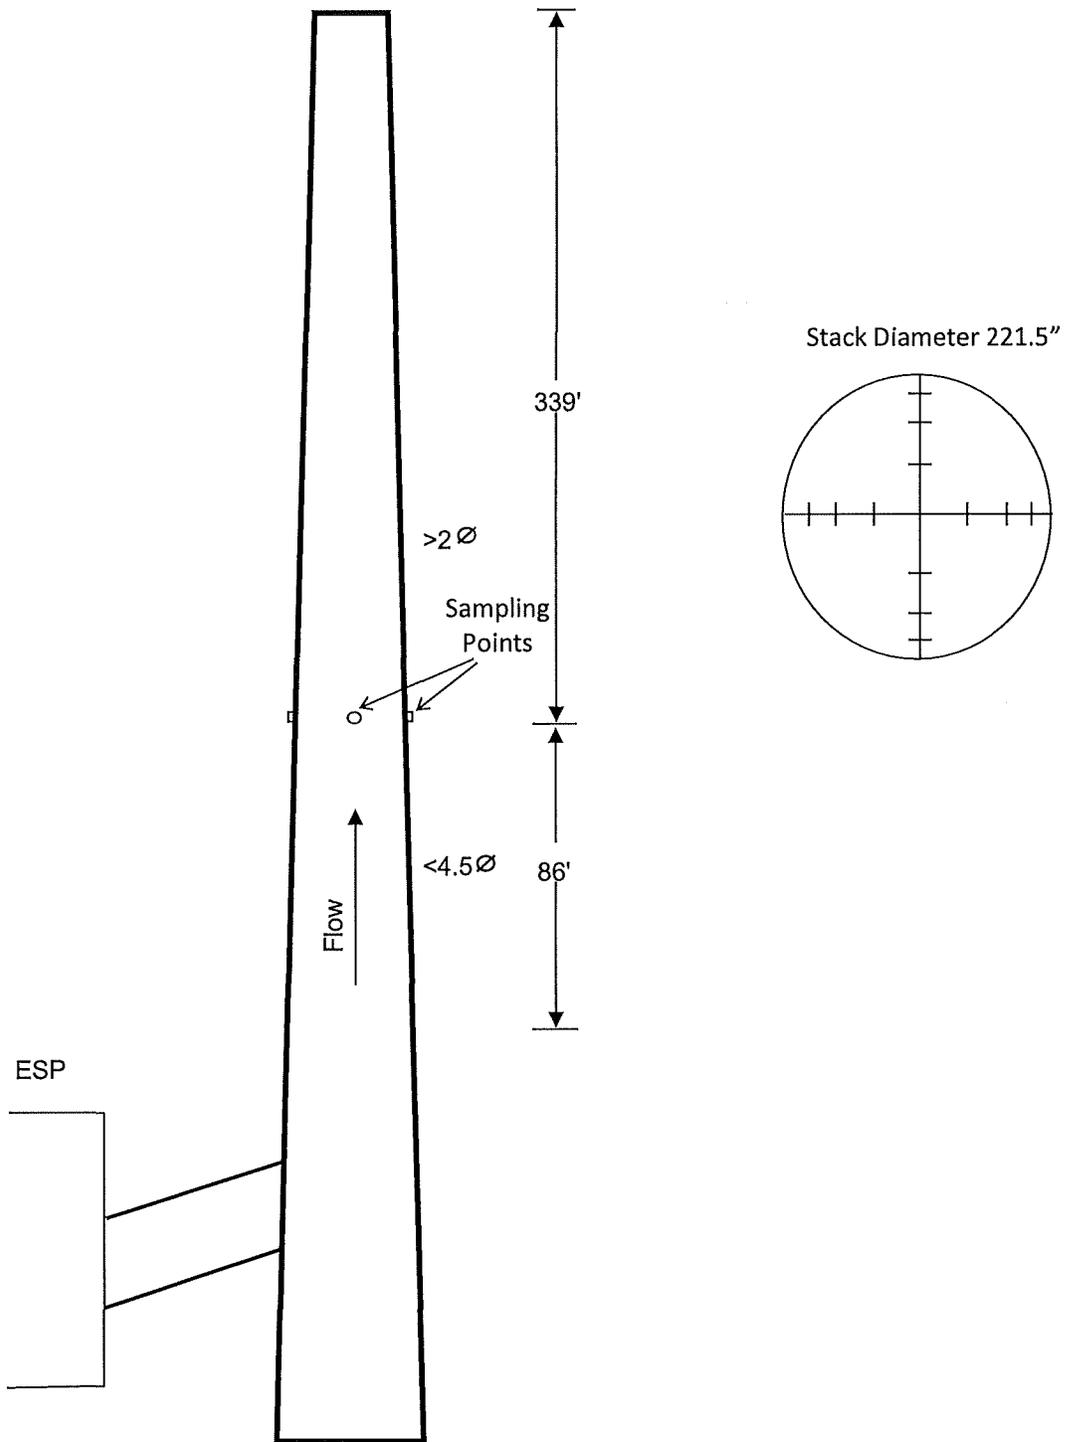

DTE

Figure 2 – USEPA Method 26A (Modified)

Trenton Channel Power Plant

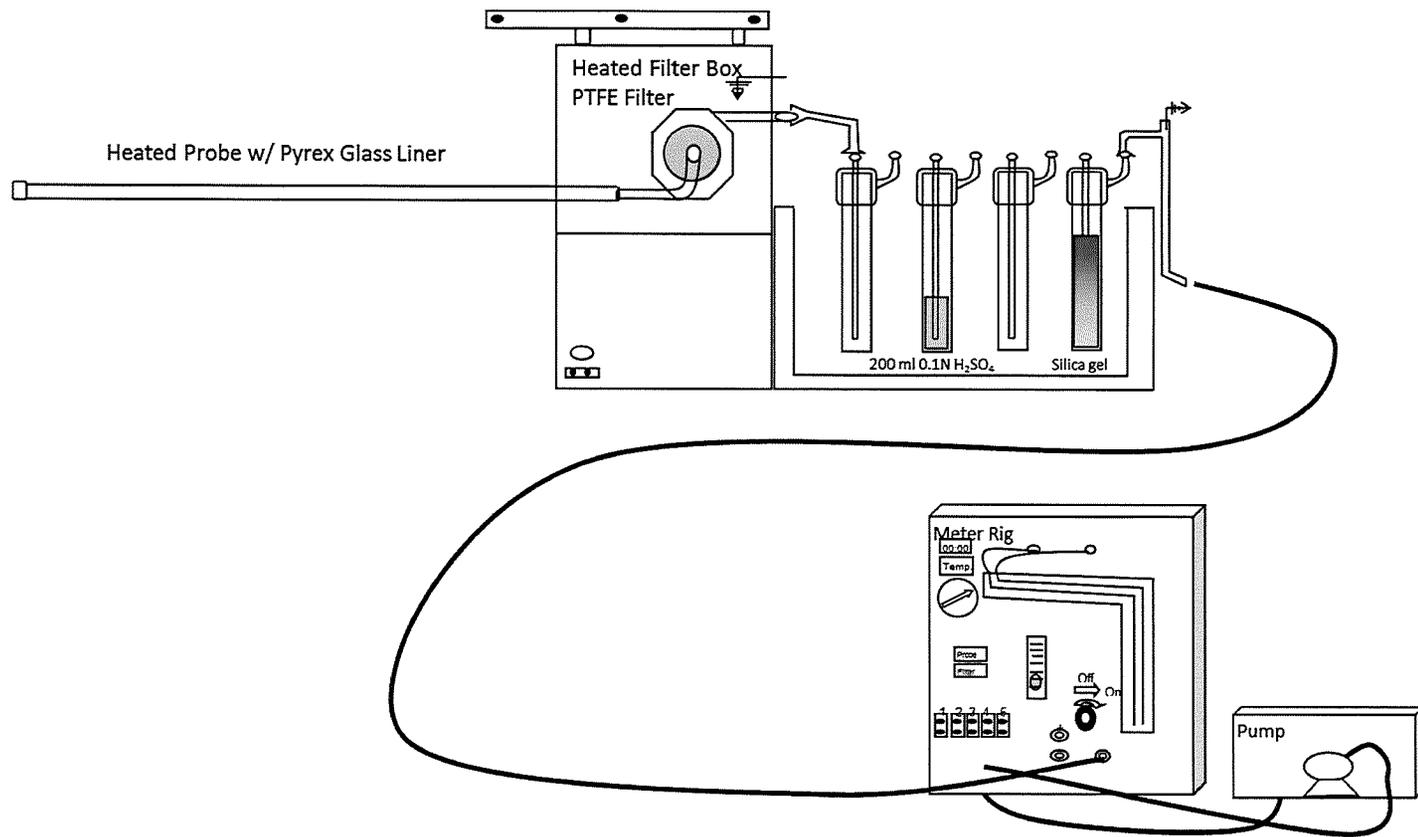

DTE

APPENDIX A

**TEST PLAN AND
APPROVAL LETTER**