



Particulate Emission Compliance Test Report

**We Energies
Presque Isle Power Plant
Flue 8 Stack
Marquette, Michigan
June 4, 2015**

RECEIVED

AUG 06 2015

AIR QUALITY DIV.

**Report Submittal Date:
July 16, 2015**

© Copyright 2015
All rights reserved in
Mostardi Platt

Project No. M152202N

1.0 EXECUTIVE SUMMARY

MOSTARDI PLATT conducted a particulate emissions compliance test program for We Energies at the Presque Isle Power Plant on the Flue 8 Stack in Marquette, Michigan on June 4, 2015. This report summarizes the results of the test program and test methods used.

The test location, test date, and test parameter are summarized below.

TEST INFORMATION		
Test Location	Test Date	Test Parameter
Flue 8 Stack	June 4, 2015	Filterable Particulate Matter (PM) (Method 5)

The purpose of this test program was to evaluate the particulate emissions on the Flue 8 Stack during normal operating conditions to satisfy compliance requirements of the operating permit. Selected results of the test program are summarized below. A complete summary of emission test results follows the narrative portion of this report.

TEST RESULTS			
Test Location	Test Date	Parameter	Emission Rates
Flue 8 Stack	6/4/15	lb/hr	5.915
		lb/mmBtu	0.0068

All times recorded are CEMs times.

The identifications of individuals associated with the test program are summarized below.

TEST PERSONNEL INFORMATION		
Location	Address	Contact
Test Coordinator	We Energies Presque Isle Power Plant Marquette, Michigan	Ms. Brenda Bergemann (414) 221-2459 (phone) Brenda.Bergemann@we-energies.com
Testing Company Representative	Mostardi Platt 888 Industrial Drive Elmhurst, Illinois 60126	Mr. Timothy A. Mei (630) 993-2100 (phone) tmei@mp-mail.com

The test crew consisted of Messrs. A. Hasan, L. Sorce, R. Iozzo, S. Van Daal, A. Tracy, and T. Mei of Mostardi Platt.

2.0 TEST METHODOLOGY

Emissions testing was conducted following the methods specified in 40 CFR, Part 60, Appendix A. A drawing depicting the sampling ports and test point locations is found in Appendix B, drawings depicting sampling trains are found in Appendix C, explanations of nomenclature and calculations are found in Appendix D, sample analysis data are found in Appendix E, reference method data are found in Appendix F, field data sheets are found in Appendix G and calibration data are found in Appendix H. Operating data are found in Appendix A.

The following methodologies were used during the test program:

Method 1 Sample and Velocity Traverse Determination

Test measurement points were selected in accordance with Method 1. The characteristics of the measurement location are summarized below.

TEST POINT INFORMATION				
Location	Upstream Diameters	Downstream Diameters	Test Parameter	Number of Sampling Points
Flue 8 Stack	> 2.0	> 8.0	PM	12

Method 2 Volumetric Flow Rate Determination

Gas velocity was measured following Method 2, for purposes of calculating the gas volumetric flow rate. An S-type pitot tube, incline manometer, thermocouple and temperature readout were used to determine gas velocity at each sample point at the Flue 8 Stack test location. All of the equipment used was calibrated in accordance with the specifications of the Method. Calibration data are presented in Appendix H.

Method 3A Carbon Dioxide (CO₂) and Oxygen (O₂) Determination

Stack gas carbon dioxide (CO₂) and oxygen (O₂) content was determined in accordance with Method 3A. A Servomex analyzer was used to determine flue gas CO₂ and O₂. All of the equipment used was calibrated in accordance with the specifications of the Method. Calibration data are presented in Appendix H and copies of the gas cylinder certifications are found in Appendix I.

Method 5 Particulate Determination

Stack gas particulate concentrations and emission rates were determined in accordance with Method 5, 40 CFR, Part 60, Appendix A. An Environmental Supply Company, Inc. sampling train was used to sample stack gas at an isokinetic rate, as specified in the Method. Particulate matter in the sample probe was recovered using an acetone rinse. The probe wash and filter catch were analyzed by Mostardi Platt in accordance with the Method in the Elmhurst, Illinois laboratory. Laboratory data are found in Appendix E. All of the equipment used was calibrated in accordance with the specifications of the Method. Calibration data are presented in Appendix H.

3.0 TEST RESULT SUMMARY

Client: We Energies
Facility: Presque Isle Power Plant
Test Location: Flue 8 Stack
Test Method: 5

	Source Condition	Full Load	Full Load	Full Load	
	Date	6/4/15	6/4/15	6/4/15	
	Start Time	13:35	15:20	16:45	
	End Time	14:40	16:25	17:50	
		Run 1	Run 2	Run 3	Average
Stack Conditions					
Average Gas Temperature, °F		321.3	324.8	321.2	322.4
Flue Gas Moisture, percent by volume		11.0%	11.0%	10.9%	11.0%
Average Flue Pressure, in. Hg		28.84	28.84	28.84	28.84
Gas Sample Volume, dscf		46.320	45.678	46.630	46.209
Average Gas Velocity, ft/sec		86.348	86.858	86.793	86.666
Gas Volumetric Flow Rate, acfm		367,233	369,402	369,124	368,586
Gas Volumetric Flow Rate, dscfm		212,823	213,287	214,353	213,488
Gas Volumetric Flow Rate, scfm		239,203	239,568	240,486	239,752
Average %CO ₂ by volume, dry basis		12.6	13.4	12.7	12.9
Average %O ₂ by volume, dry basis		7.2	6.3	7.0	6.8
Isokinetic Variance		102.0	100.4	102.0	101.5
Fd Factor, dscf/mmBtu		9,820.0	9,820.0	9,820.0	9,820.0
Filterable Particulate Matter (Method 5)					
grams collected		0.0167	0.0062	0.0062	0.0097
grains/acf		0.0032	0.0012	0.0012	0.0019
grains/dscf		0.0056	0.0021	0.0021	0.0033
lb/hr		10.148	3.829	3.769	5.915
lb/mmBtu (Standard Fd Factor)		0.0119	0.0042	0.0043	0.0068

RECEIVED

AUG 06 2015

4.0 CERTIFICATION


AIR QUALITY DIV.

MOSTARDI PLATT is pleased to have been of service to We Energies. If you have any questions regarding this test report, please do not hesitate to contact us at 630-993-2100.

CERTIFICATION

As project manager, I hereby certify that this test report represents a true and accurate summary of emissions test results and the methodologies employed to obtain those results, and the test program was performed in accordance with the methods specified in this test report.

MOSTARDI PLATT

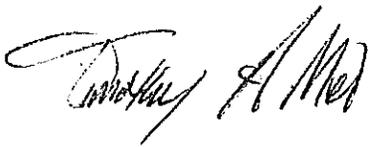

Timothy A. Mei

Program Manager



Scott W. Banach

Quality Assurance