

EXECUTIVE SUMMARY

Consumers Energy Regulatory Compliance Testing Section (RCTS) conducted nitrogen oxides (NO_x), carbon monoxide (CO), and volatile organic compound (VOC) testing at the exhaust location of a newly constructed Caterpillar Model G3412C engine (aka EUEMERGGEN), installed at the Consumers Energy Northville Compressor Station in Northville, Michigan. EUEMERGGEN is natural gas-fired, four-stroke lean-burn (4SLB), spark ignited (SI), reciprocating internal combustion engine (RICE), ≥130 horsepower that powers an emergency generator to provide electricity for the site during power outages.

The test program was conducted on October 27, 2020 following the Test Protocol submitted September 23, 2020 to Michigan Department of Environment, Great Lakes, and Energy (EGLE) to satisfy performance testing requirements and evaluate initial compliance with 40 CFR Part 60, Subpart JJJJ, *Standards of Performance for Stationary Spark Ignition Internal Combustion Engines*, (aka NSPS SI ICE). While the engine is also subject to 40 CFR Part 63, Subpart ZZZZ, *National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines*, pursuant to 40 CFR §63.6590(c)(1), compliance is demonstrated by meeting the requirements of Subpart JJJJ. There were no deviations from the approved stack test protocol during the emissions test.

Three, 60-minute test runs were conducted at the engine exhaust following procedures in United States Environmental Protection Agency (USEPA) Reference Methods (RM) 1/1A, 3A, 4/ALT-008, 7E, 10, 19, and 25A/ALT-096 in 40 CFR Part 60, Appendix A. During testing, EUEMERGGEN operated at horsepower and load conditions within plus or minus (±) 10 percent of 100 percent peak (or the highest achievable) load, as specified in 40 CFR 60.4244(a).

The results of the EUEMERGGEN testing indicate the NO_x, CO, and VOC emissions are compliant with applicable emissions limits. The results of the emissions testing are summarized in Table E-1 below.

**Table E-1
Summary of Test Results**

Parameter	Units	Average Result of 3 Test Runs	Subpart JJJJ ¹ Emission Limit
NO _x	g/HP-hr	1.1	2.0
	ppmvd at 15% O ₂	79	160
CO	g/HP-hr	1.7	4.0
	ppmvd at 15% O ₂	206	540
VOC [†]	g/HP-hr	0.6	1.0
	ppmvd at 15% O ₂	49	86

NO_x nitrogen oxides
CO carbon monoxide
VOC volatile organic compounds (non-methane, non-ethane organic compounds), as propane
g/HP-hr grams per horsepower hour
ppmvd at 15% O₂ parts per million by volume, dry basis, at 15% oxygen

¹ Owners and operators of stationary non-certified SI engines may choose to comply with the emission standards in units of either g/HP-hr or ppmvd at 15 percent O₂

[†] 40 CFR Part 60, Subpart JJJJ refers to volatile organic compounds as defined in 40 CFR, Part 51.100(s)(1) which defines VOC as "any compound of carbon...other than the following, which have been determined to have negligible photochemical reactivity: methane, ethane... Therefore, Subpart JJJJ exhaust gas measurements of VOC include only the total non-methane, non-ethane organic compounds.

Detailed results are presented in Appendix Table 1. Sample calculations and field data sheets are presented in Appendices A, and B. Engine operating data and supporting documentation are provided in Appendices C and D.

1.0 INTRODUCTION

This report summarizes the results of compliance air emissions testing conducted October 27, 2020 at the Consumers Energy Northville Compressor Station in Northville, Michigan. This document follows the Michigan Department of Environment, Great Lakes and Energy (EGLE) format described in the November 2019, *Format for Submittal of Source Emission Test Plans and Reports*. Reproducing only a portion of this report may omit critical substantiating documentation or cause information to be taken out of context. If any portion of this report is reproduced, please exercise due care in this regard.

1.1 IDENTIFICATION, LOCATION, AND DATES OF TESTS

Consumers Energy Regulatory Compliance Testing Section (RCTS) conducted nitrogen oxides (NO_x), carbon monoxide (CO), and volatile organic compound (VOC) testing at the existing stationary, spark-ignition (SI), reciprocating internal combustion engine (RICE), identified as EUEMERGGEN, installed at the Northville Compressor Station in Northville, Michigan on October 27, 2020.

A Test Protocol submitted to EGLE on September 23, 2020 was subsequently approved by Mr. Mark Dziadosz, EGLE Environmental Quality Analyst, in a letter dated October 14, 2020. There were no deviations from the approved stack test protocol during the emissions test.

1.2 PURPOSE OF TESTING

The test program was performed to satisfy performance-testing requirements and evaluate initial compliance with 40 CFR Part 60, Subpart JJJJ, *Standards of Performance for Stationary Spark Ignition Internal Combustion Engines*, (aka NSPS SI ICE). The applicable emission limits are presented in Table 1-1.

**Table 1-1
Applicable Emission Limits**

Parameter	Emission Limit	Units	Applicable Requirement
NO _x	2.0	g/HP-hr	40 CFR Part 60, Subpart JJJJ ¹
	160	ppmvd at 15% O ₂	40 CFR Part 60, Subpart JJJJ ¹
CO	4.0	g/HP-hr	40 CFR Part 60, Subpart JJJJ ¹
	540	ppmvd at 15% O ₂	40 CFR Part 60, Subpart JJJJ ¹
VOC [†]	1.0	g/HP-hr	40 CFR Part 60, Subpart JJJJ ¹
	86	ppmvd at 15% O ₂	40 CFR Part 60, Subpart JJJJ ¹
NO _x	nitrogen oxides		
CO	carbon monoxide		
VOC	volatile organic compounds (non-methane, non-ethane organic compounds) as propane		
g/HP-hr	grams per horsepower hour		
ppmvd at 15% O ₂	parts per million by volume, dry basis, at 15% oxygen		
¹	Owners and operators of stationary non-certified SI engines may choose to comply with the emission standards in units of either g/HP-hr or ppmvd at 15 percent O ₂		
[†]	40 CFR Part 60, Subpart JJJJ refers to volatile organic compounds as defined in 40 CFR, Part 51.100(s)(1) which defines VOC as "any compound of carbon...other than the following, which have been determined to have negligible photochemical reactivity: methane, ethane... Therefore, Subpart JJJJ exhaust gas measurements of VOC include only the total non-methane, non-ethane organic compounds.		

1.3 BRIEF DESCRIPTION OF SOURCE

EUEMERGGEN is a natural gas-fired, four-stroke lean-burn (4SLB), spark ignited (SI), reciprocating internal combustion engine (RICE), ≥130 horsepower that powers an emergency electric generator to provide electricity for the site during power outages. The new engine, identified as EUEMERGGEN, was installed to replace the emergency generator (EUAUXGENERATOR) that is currently identified in the site-wide renewable operating permit MI-ROP-N1099-2017.

1.4 CONTACT INFORMATION

Table 1-2 presents the names, addresses, and telephone numbers of the contacts for information regarding the test and the test report, and names and affiliation of personnel involved in conducting the testing.

**Table 1-2
Contact Information**

Program Role	Contact	Address
State Regulatory Administrator	Ms. Karen Kajiya-Mills Technical Programs Unit Manager 517-335-4874 kajiya-millsk@michigan.gov	EGLE-Air Quality Division Constitution Hall, 2nd Floor South 525 W. Allegan, Lansing, Michigan 48933
State District Supervisor	Dr. April Wendling District Supervisor 313-588-0037 wendlinga@michigan.gov	EGLE - Detroit District Office Cadillac Place, Suite 2-300 3058 West Grand Boulevard Detroit, Michigan 48202-6058
State Regulatory Inspector	Mr. Stephen Weiss Environmental Quality Analyst 313-720-5831 weiss@michigan.gov	EGLE - Detroit District Office Cadillac Place, Suite 2-300 3058 West Grand Boulevard Detroit, Michigan 48202-6058
State Technical Programs Inspector	Mr. Mark Dziadosz Environmental Quality Analyst 586-854-1611 dziadoszm@michigan.gov	EGLE – Warren District Office 27700 Donald Court Warren, Michigan 48092-2793
Responsible Official	Mr. Avelock Robinson Director-Gas Compression Operations 586-716-3326 avelock.robinson@cmsenergy.gov	Consumers Energy Company St. Clair Compressor Station 10021 Marine City Highway Ira, Michigan 48023
Corporate Air Quality Contact	Ms. Amy Kapuga Senior Engineer 517-788-2201 amy.kapuga@cmsenergy.com	Consumers Energy Company Environmental Services Department 1945 West Parnall Road Jackson, Michigan 49201
Field Environmental Coordinator	Mr. Gerald Rand Senior Environmental Analyst 734-850-4209 frank.rand@cmsenergy.com	Consumers Energy Company South Monroe Service Center 7216 Crabb Road Temperance, Michigan 48182
Test Facility	Mr. Paul Jergens Senior Engineer Lead II 248-735-4205 paul.jergens@cmsenergy.com	Consumers Energy Company Northville Compressor Station 9440 Napier Road Northville, Michigan 48167
Test Team Representative	Mr. Thomas Schmelter, QSTI Engineering Technical Analyst 616-738-3234 thomas.schmelter@cmsenergy.com	Consumers Energy Company L&D Training Center 17010 Croswell Street West Olive, Michigan 49460

2.0 SUMMARY OF RESULTS

2.1 OPERATING DATA

During the compliance test, the engine fired natural gas and pursuant to §60.4244(a), and the engine was operated at the highest achievable load. The performance testing was conducted with the engine operating at an average load of 78% horsepower and 84% electrical output, based on the maximum manufacturer's engine and generator design capacities of 755 horsepower and 500 kilowatts. Refer to Appendix C for detailed operating data from the facility's data acquisition system and operating readings.

2.2 APPLICABLE PERMIT INFORMATION

The Northville Compressor Station operates in accordance with MI-ROP-N1099-2017. EUEMERGGEN was installed to replace the emergency generator (EUAUXGENERATOR) that is currently identified in the site-wide renewable operating permit MI-ROP-N1099-2017. The maximum rated heat input capacity of EUEMERGGEN is less than 10,000,000 Btu/hr, and the potential to emit for all criteria pollutants are less than the applicable significant emission rates. Therefore, pursuant to R 336.1285(2)(g), installation of EUEMERGGEN did not require a permit to install. The required Subpart JJJJ construction and initial startup notifications were submitted to EGLE.

2.3 RESULTS

The results of the EUEMERGGEN testing indicate the NO_x, CO, and VOC emissions are compliant with applicable emissions limits. Refer to Table 2-1 for a summary of the test results.

**Table 2-1
Summary of Test Results**

Parameter	Units	Average Result of 3 Test Runs	Subpart JJJJ ¹ Emission Limit
NO _x	g/HP-hr	1.1	2.0
	ppmvd at 15% O ₂	79	160
CO	g/HP-hr	1.7	4.0
	ppmvd at 15% O ₂	206	540
VOC [†]	g/HP-hr	0.6	1.0
	ppmvd at 15% O ₂	49	86
NO _x	nitrogen oxides		
CO	carbon monoxide		
VOC	volatile organic compounds (non-methane, non-ethane organic compounds), as propane		
g/HP-hr	grams per horsepower hour		
ppmvd at 15% O ₂	parts per million by volume, dry basis, at 15% oxygen		
¹ Owners and operators of stationary non-certified SI engines may choose to comply with the emission standards in units of either g/HP-hr or ppmvd at 15 percent O ₂			
[†] 40 CFR Part 60, Subpart JJJJ refers to volatile organic compounds as defined in 40 CFR, Part 51.100(s)(1) which defines VOC as "any compound of carbon...other than the following, which have been determined to have negligible photochemical reactivity: methane, ethane... Therefore, Subpart JJJJ exhaust gas measurements of VOC include only the total non-methane, non-ethane organic compounds.			

Detailed results can be found in Appendix Table 1. A discussion of the results is shown in Section 5.0. Sample calculations and field data sheets are presented in Appendices A and B. Engine operating data and supporting documentation are provided in Appendices C and D.

3.0 SOURCE DESCRIPTION

EUEMERGGEN is operated as an emergency SI ICE in the event of a site power outage. A summary of the engine specifications from the manufacturer's gas engine site-specific technical data is presented in Table 3-1.

Table 3-1
Engine Specifications

Parameter ¹	EUEMERGGEN
Model Year / Initial Startup	2019 / December 16, 2019
Make	Caterpillar
Model	G3412C
Serial No.	SPP00276
Output (brake-horsepower)	755
Heat Input (mmBtu/hr)	6.30
Exhaust Gas Temp. (°F)	769
Engine Outlet O ₂ (Vol-%, dry)	8.6
¹ Engine specifications are based upon vendor data for operation at 100% of rated engine capacity.	


3.1 PROCESS

The Northville Compressor Station is a natural gas transmission and storage facility. The facility operates EUEMERGGEN to turn an emergency generator that provides electricity during power outages.

EUEMERGGEN is a natural gas-fired 4SLB SI RICE constructed in August 2019. In a four-stroke engine, air is aspirated into the cylinder during the downward travel of the piston on the intake stroke. The fuel charge is injected when the piston is near the bottom of the intake stroke; the intake ports close as the piston moves to the top of the cylinder, compressing the air/fuel mixture. The ignition and combustion of the air/fuel charge begins the downward movement of the piston called the power stroke. As the piston reaches the bottom of the power stroke, valves open and combustion products are expelled from the cylinder as the piston travels upward. A new air-to-fuel charge is injected as the piston moves downward with a new intake stroke.

The engine provides mechanical shaft power to an electricity-producing generator. Refer to Figure 3-1 for a four-stroke engine process diagram.

Figure 3-1. Four-Stroke Engine Process Diagram

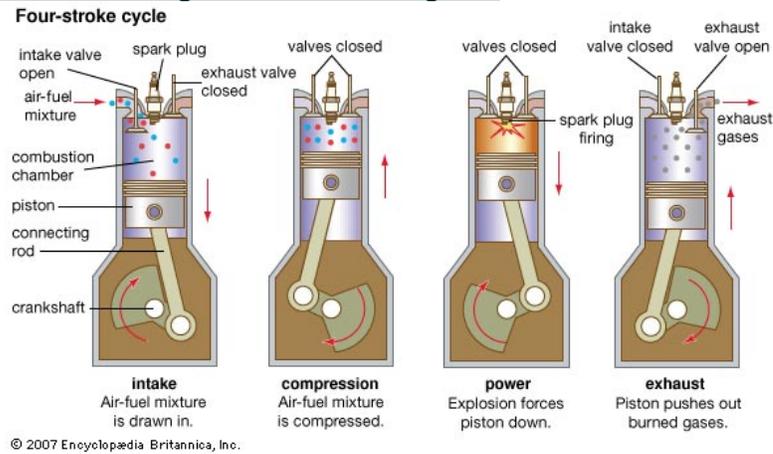

The natural gas-fired engine is controlled through parametric controls (i.e., timing and air-to-fuel ratio), and lean burn combustion technology to limit air emissions. The Caterpillar engine includes an Advanced Digital Engine Management (ADEM) electronic control system. The ADEM electronic controls integrate governing (engine sensing and monitoring, air/fuel ratio control, ignition timing, and detonation control) into one comprehensive engine control system for optimum performance and reliability.

The NO_x emissions are minimized using lean-burn combustion technology. Lean-burn combustion refers to a high level of excess air (generally 50% to 100% relative to the stoichiometric amount) in the combustion chamber. The excess air absorbs heat during the combustion process, thereby reducing the combustion temperature and pressure and resulting in lower NO_x emissions.

Detailed operating data recorded during testing are provided in Appendix C.

3.2 PROCESS FLOW

Located in northwest Wayne County, the Northville Compressor Station is a natural gas transmission and storage facility. The site pumps natural gas into and out of underground storage reservoirs and maintains the pressure along the pipeline system. During normal seasonal weather patterns, natural gas is purchased for storage injection in April through October and withdrawn from storage reservoirs in November through March.

EUEMERGGEN maintains station electric power during a commercial power outage. The natural gas engine generator set is designed to start and supply power before equipment shutdowns to maintain station operation. The emergency generator engine was the focus of this test program. Refer to Figure 3-2 for the Northville Compressor Station Site Map depicting the EUEMERGGEN location.

Figure 3-2. Northville Compressor Station Site Map



3.3 MATERIALS PROCESSED

The fuel utilized in EUEMERGGEN is exclusively natural gas, as defined in 40 CFR 72.2. During testing, the natural gas combusted within the engine was comprised of approximately 93% methane, 6% ethane, 0.3% nitrogen, and 0.2% carbon dioxide. The daily natural gas chromatograph analysis results are provided in Appendix C. The gas composition and Btu content were used to calculate site-specific F factors in accordance with United States Environmental Protection Agency (USEPA) Method 19 and used in emission rate calculations.

3.4 RATED CAPACITY

EUEMERGGEN has a maximum power output of approximately 755 horsepower, and as equipped with the electric generator, a maximum electrical output of 500 kilowatts. The engine has a rated heat input of 6.30 million British thermal units per hour (mmBtu/hour). Engine operating parameters were recorded and averaged for each test run. Refer to Appendix C for operating data recorded during testing.

3.5 PROCESS INSTRUMENTATION

The engine operating parameters were continuously monitored by a distributed control system for the Caterpillar engine, data acquisition systems, and by Consumers Energy personnel during testing. Data were collected during each test for the following parameters:

- Engine speed (rpm)
- Power (Kilowatts)
- Fuel flow (scfm)
- Horsepower (hp)

The horsepower of the engine was calculated based on the following:

$$1 \text{ kilowatt (kW)} = 1.35962 \text{ Horsepower (hp)}$$

Refer to Appendix C for operating data.

4.0 SAMPLING AND ANALYTICAL PROCEDURES

Consumers Energy RCTS tested for NO_x, CO, VOC, and oxygen (O₂) concentrations using the USEPA test methods presented in Table 4-1. The sampling and analytical procedures associated with each parameter are described in the following sections.

**Table 4-1
Test Methods**

Parameter	USEPA	
	Method	Title
Sample traverses	1 1A	Sample and Velocity Traverses for Stationary Sources Sample and Velocity Traverses for Stationary Sources with Small Stacks or Ducts
Oxygen	3A	Determination of Oxygen and Carbon Dioxide Concentrations in Emissions from Stationary Sources (Instrumental Analyzer Procedure)
Moisture content	4 ALT-008	Determination of Moisture Content in Stack Gases Alternative Moisture Measurement Method–Midget Impingers
Nitrogen oxides (NO _x)	7E	Determination of Nitrogen Oxides Emissions from Stationary Sources (Instrumental Analyzer Procedure)
Carbon monoxide (CO)	10	Determination of Carbon Monoxide Emissions from Stationary Sources (Instrumental Analyzer Procedure)
Emission rates	19	Sulfur Dioxide Removal and Particulate, Sulfur Dioxide and Nitrogen Oxides from Electric Utility Steam Generators
Volatile organic compounds	25A ALT-096	Determination of Total Gaseous Organic Concentration Using a flame Ionization Analyzer Alternative testing approach using the TECO-55I to measure methane and NMOC.

4.1 DESCRIPTION OF SAMPLING TRAIN AND FIELD PROCEDURES

The test matrix presented in Table 4-2 summarizes the sampling and analytical methods performed for the specified parameters during this test program.

**Table 4-2
Test Matrix**

Date (2020)	Run	Sample Type	Start Time (EDT)	Stop Time (EDT)	Test Duration (min)	EPA Test Method	Comment
October 27	1	O ₂ NO _x CO VOC	9:30	10:29	60	1 3A	Three-point sample at exhaust stack
	2		11:00	11:59	60	4 (ALT-008) 7E 10	Single-point sample at exhaust stack
	3		12:30	13:29	60	19 25A (ALT-096)	Single-point sample at exhaust stack

4.2 SAMPLE LOCATION AND TRAVERSE POINTS (USEPA METHOD 1/1A)

The number and location of traverse points was evaluated according to the requirements in Table 2 of 40 CFR Part 60, Subpart JJJJ, USEPA Method 1, *Sample and Velocity Traverses for Stationary Sources*, and USEPA Method 1A, *Sample and Velocity Traverses for Stationary Sources with Small Stacks or Ducts*. The sampling location for EUEMERGGEN is described as:

Sample Port in 9-inch diameter duct:

- Approximately 79-inches or 8.8 duct diameters downstream of a flow disturbance where the engine exhaust makes a 90 degree turn, and
- Approximately 11-inches or 0.8 duct diameters upstream of the exit to atmosphere.

The sample ports are 3-inches in diameter and extend approximately 1 inch beyond the stack wall.

A three traverse point stratification test was performed using parameter concentrations from Run 1 in accordance with USEPA Method 7E, §8.1.2. Flue gas was sampled from 3 traverse points located at 16.7, 50.0, and 83.3% of the measurement line at approximately equal intervals during the test for Run 1. The individual point and mean parameter concentrations were calculated, and the gas stream was considered unstratified; therefore, parameter concentrations were measured from a single point near the centroid of the stack for Runs 2 and 3.

Figure 4-1. EUEMERGGEN Sampling Location




4.3 MOISTURE CONTENT (USEPA METHOD 4/ALT-008)

Exhaust gas moisture content was determined in accordance with USEPA ALT-008, *Alternative Moisture Measurement Method Midget Impingers*, an alternative method for correcting pollutant concentration data to appropriate moisture conditions (e.g. pollutant and/or air flow data on a dry or wet basis) validated May 19, 1993 by the USEPA Emission Measurement Branch. The procedure is incorporated into Method 6A of 40 CFR Part 60 and is based on field validation tests described in *An Alternative Method for Stack Gas Moisture*

Determination (Jon Stanley, Peter Westlin, 1978, USEPA Emissions Measurement Branch). The sample apparatus configuration follows the general guidelines contained in Figure 4-2 and §8.2 of USEPA Method 4, *Determination of Moisture Content in Stack Gases*, and ALT-008 Figure 1 or 2.

The flue gas is withdrawn from the stack at a constant rate through a sample probe, Teflon tubing, four midget impingers, and a metering console with pump. The moisture is removed from the gas stream in ice-bath chilled impingers and determined gravimetrically. The mass of condensate collected and the volume of flue gas sampled are used to calculate the moisture content. Refer to Figure 4-2 for a depiction of the ALT-008 Moisture Sample Apparatus.

Figure 4-2. ALT-008 Moisture Sample Apparatus

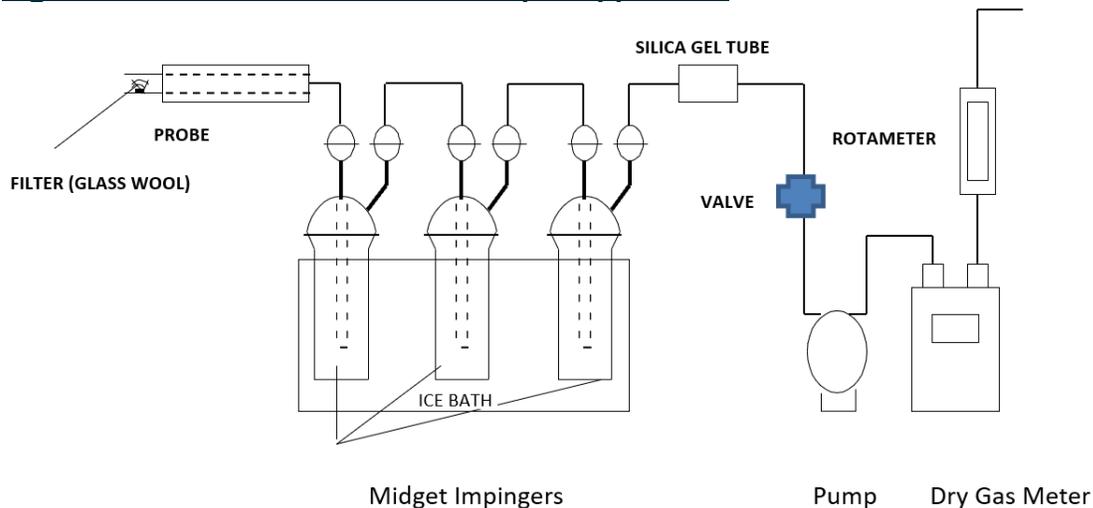

*The silica gel tube depicted in the figure above was replaced with a midget impinger (bubbler) with a straight tube insert, as allowed in ALT-008, §1.

4.4 O₂, NO_x, AND CO (USEPA METHODS 3A, 7E, AND 10)


Oxygen, nitrogen oxides, and carbon monoxide concentrations were measured using the following sampling and analytical procedures:

- USEPA Method 3A, *Determination of Oxygen and Carbon Dioxide Concentrations in Emissions from Stationary Sources (Instrumental Analyzer Procedure)*,
- USEPA Method 7E, *Determination of Nitrogen Oxides Emissions from Stationary Sources (Instrumental Analyzer Procedure)*, and
- USEPA Method 10, *Determination of Carbon Monoxide Emissions from Stationary Sources (Instrumental Analyzer Procedure)*.

The sampling procedures of the methods are similar, except for the analyzers and analytical technique used to quantify the parameters of interest. The measured oxygen concentrations were used to adjust the pollutant concentrations to 15% O₂ and calculate pollutant emission rates.

Engine exhaust gas was extracted from the stack through a stainless-steel probe, heated Teflon® sample line, and through a gas conditioning system to remove water and dry the sample before entering a sample pump, flow control manifold, and gas analyzers. Figure 4-3 depicts a drawing of the Methods 3A, 7E, and 10 sampling system.

Figure 4-3. USEPA Methods 3A, 7E, and 10 Sampling System

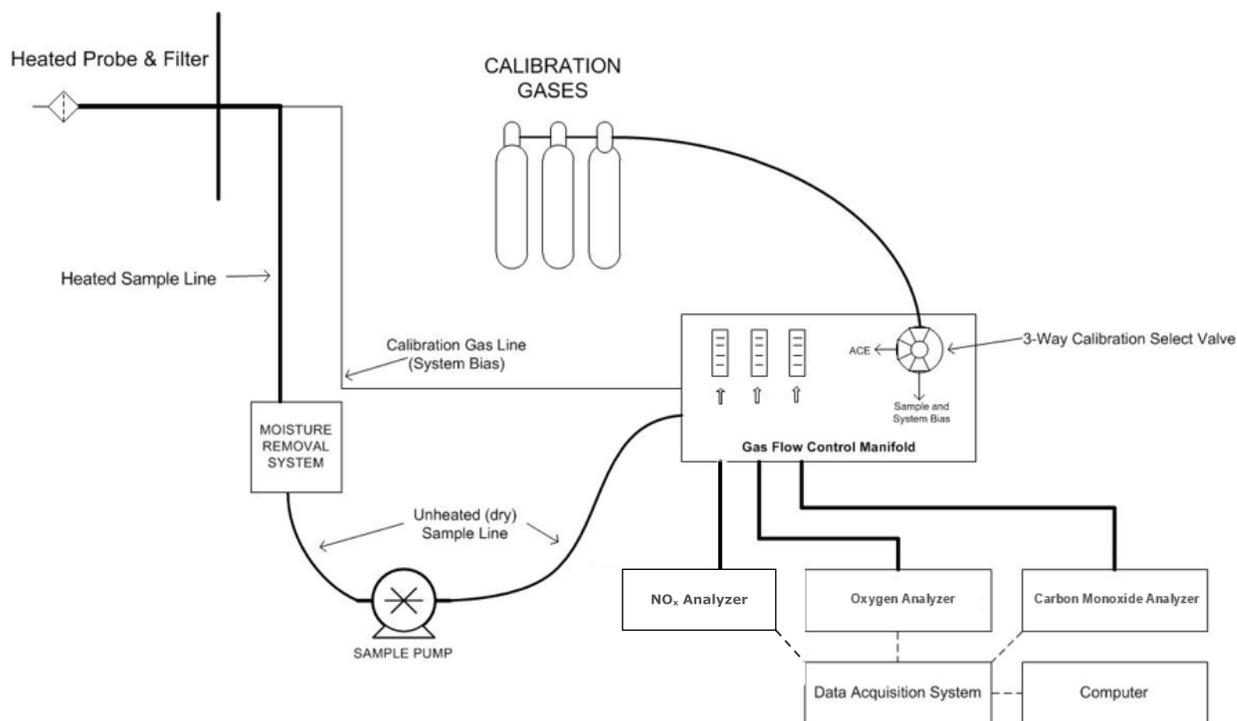

Prior to sampling engine exhaust gas, the analyzers were calibrated by performing a calibration error test where zero-, mid-, and high-level calibration gases were introduced directly to the back of the analyzers. The calibration error check was performed to evaluate if the analyzers response was within $\pm 2.0\%$ of the calibration gas span or high calibration gas concentration. An initial system-bias test was performed where the zero- and mid- or high- calibration gases were introduced at the sample probe to measure the ability of the system to respond accurately to within $\pm 5.0\%$ of span.

A NO_2 to NO conversion test was performed on the NO_x analyzer prior to beginning the test program to evaluate the ability of the instrument to convert NO_2 to NO before analyzing for NO_x . The test verified the analyzer response as NO_x was $\geq 90\%$ of the certified NO_2 calibration gas concentration.

Upon successful completion of the calibration error and initial system bias tests, sample flow rate and component temperatures were verified and the probe was inserted into the duct at the appropriate traverse point. After confirming the engine was operating at established conditions, the test run was initiated. Gas concentrations were recorded at 1-minute intervals throughout each 60-minute test run.

After the conclusion of each test run, a post-test system bias check was performed to evaluate analyzer bias and drift from the pre- and post-test system bias checks. The system-bias checks evaluated if the analyzers bias was within $\pm 5.0\%$ of span and drift was within $\pm 3.0\%$. The analyzers responses were used to correct the measured gas concentrations for analyzer drift.

For the analyzer calibration error tests, bias tests and drift checks, these evaluations are also passed if the standard criteria are not achieved, but the absolute difference between the analyzer responses and calibration gas is less than or equal to 0.5 ppmv for NO_x and CO or 0.5% for O_2 .

4.5 EMISSION RATES (USEPA METHOD 19)

USEPA Method 19, *Determination of Sulfur Dioxide Removal Efficiency and Particulate Matter, Sulfur Dioxide, and Nitrogen Oxide Emission Rates*, was used to calculate a fuel specific F_c factor and exhaust gas flowrate. The natural gas processed by the Northville Compressor Station is the same gas used to fire EUEMERGGEN. The facility collects a daily sample of this gas and analyzes it via gas chromatography (GC) for hydrocarbons, non-hydrocarbons, heating value, and other parameters. The test day GC results were obtained to calculate F_w , F_d , and F_c factors (ratios of combustion gas volumes to heat inputs) using USEPA Method 19 Equations 19-13 (F_d), 19-14 (F_w), and 19-15 (F_c). The F_d factor was used to calculate the exhaust gas flow rate using *Equation 19-1* presented in Figure 4-4, which was incorporated into 40 CFR Part 60 Subpart JJJJ *Equations 1, 2, and 3* to calculate g/HP-hr emission rates.

Figure 4-4. USEPA Method 19 Exhaust Flow Rate Equation 19-1

$$Q_s = F_d H \frac{20.9}{20.9 - O_2}$$

Where:

- Q_s = stack flow rate (dscf/min)
- F_d = fuel-specific oxygen-based F factor, dry basis, from Method 19 (dscf/mmBtu)
- H = fuel heat input rate, (mmBtu/min), at the higher heating value (HHV) measured at engine fuel feed line, calculated as (fuel feed rate in ft³/min) x (fuel heat content in mmBtu/ft³)
- O_2 = stack oxygen concentration, dry basis (%)

Figure 4-5. 40 CFR Part 60 Subpart JJJJ Equation 1, 2, 3

$$ER = \frac{C_d \times K \times Q \times T}{HP - hr}$$

Where:

- ER = Emission rate of pollutant in g/HP-hr
- C_d = Measured pollutant concentration in parts per million by volume, dry basis (ppmvd)
- K = Conversion constant for ppm pollutant to grams per standard cubic meter at 20°C:
 - $KNO_x = 1.912 \times 10^{-3}$ (Equation 1)
 - $KCO = 1.164 \times 10^{-3}$ (Equation 2)
 - $KVOC = 1.833 \times 10^{-3}$ (Equation 3)
- Q = Stack gas volumetric flow rate, in cubic meter per hour, dry basis
- T = Time of test run, in hours

4.6 VOLATILE ORGANIC COMPOUNDS (ALT-096: USEPA METHODS 18/25A)

VOC concentrations were measured from the engine using a Thermo Model 55i Direct Methane and Non-methane Analyzer as approved in ALT-096 and following the procedures of USEPA Method 25A, *Determination of Total Gaseous Organic Concentration Using a Flame Ionization Analyzer (FIA)*. The instrument uses a flame ionization detector (FID) to measure the exhaust gas total hydrocarbon concentration in conjunction with a gas chromatography column that separates methane from other organic compounds.

The components of the extractive sample interface apparatus are constructed of stainless steel and Teflon. Flue gas was collected from the stack via a sample probe and heated sample line and into the analyzer, which communicates with the data acquisition handling system (DAHS) via output signal cables. The analyzer uses a rotary valve and gas

chromatograph column to separate methane from hydrocarbons in the sample and quantifies these components using a flame ionization detector.


Sample gas is injected into the column and due to methane's low molecular weight and high volatility moves through the column more quickly than other organic compounds that may be present and quantified by the FID. The column is then flushed with inert carrier gas and the remaining non-methane organic compounds (NMOC) are analyzed in the FID. This analytical technique allows separate measurements for methane and non-methane organic compounds via the use of a single FID. Refer to Figure 4-6 for a drawing of the USEPA Method 25A sampling apparatus.

The field VOC instrument was calibrated with a zero air and three propane and methane in air calibration gases following USEPA Method 25A procedures at the zero level, low (25 to 35 percent of calibration span), mid (45 to 55 percent of calibration span) and high (equivalent to 80 to 90 percent of instrument span). Prior to testing, the analyzer was calibrated using hydrocarbon free zero and high-level methane and propane calibration gases, with its signal output adjusted accordingly. A calibration error test was conducted by introducing low- and mid-level calibration gases to the sample system to ensure the analyzer's response was within $\pm 5\%$ of certified concentration. During this procedure, the system response time for each calibration gas introduced to the system, equivalent to 95% of the step change, is observed.

Following each test run, zero and low-level calibration gases are introduced consecutively into the measurement system to ensure analyzer drift is within $\pm 3\%$ of span, thereby validating each test run. As requested by EGLE, the NMOC run concentrations are corrected for analyzer drift using USEPA Method 7E, *Equation 7E-5b*. The NMOC concentration, combined with the calculated volumetric flowrate, is the basis for determining mass VOC emission rates and regulatory compliance.

Since the field VOC instrument measures on a wet basis, exhaust gas moisture content was used to convert the wet VOC concentrations to a dry basis and calculate VOC mass emission rates. The ALT-008 moisture content results were used to convert the VOC concentration to a dry basis and calculate emission rates.

Figure 4-6. USEPA Method 25A NMOC Sample Apparatus

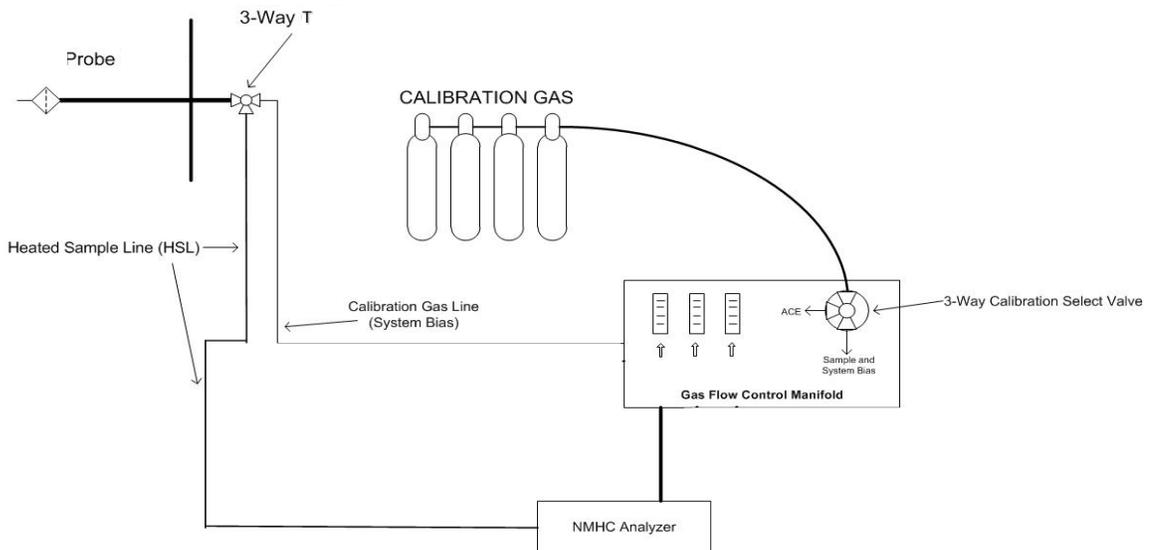

5.0 TEST RESULTS AND DISCUSSION

The test program was conducted October 27, 2020 to satisfy performance-testing requirements and evaluate compliance with 40 CFR Part 60, Subpart JJJJ, *Standards of Performance for Stationary Spark Ignition Internal Combustion Engines*.

5.1 TABULATION OF RESULTS

The results of the EUEMERGGEN testing indicate the NO_x, CO, and VOC emissions are compliant with applicable emissions limits as summarized in Table 2-1. Appendix Table 1 contains detailed tabulation of results, process operating conditions, and exhaust gas conditions for the engine.

Please note that 40 CFR Part 60, Subpart JJJJ refers to the definition of VOC found in 40 CFR, Part 51 and does not include methane or ethane. Specifically, §51.100(s)(1) defines VOC as *any compound of carbon...other than the following, which have been determined to have negligible photochemical reactivity: methane, ethane...* The Thermo 55i analyzer includes ethane as part of the NMOC measurement; therefore, the NMOC concentrations measured may reflect a positive NMOC bias.

5.2 SIGNIFICANCE OF RESULTS

The results of the testing indicate compliance with the applicable emission limits.

5.3 VARIATIONS FROM SAMPLING OR OPERATING CONDITIONS

No variations from sampling or operating conditions were encountered during testing.

5.4 PROCESS OR CONTROL EQUIPMENT UPSET CONDITIONS

There were no process or control equipment upset conditions encountered during this test program. The engine was connected to a load bank and operating at the highest achievable load (78% of engine horsepower, 84% of electrical output) during testing.

5.5 AIR POLLUTION CONTROL DEVICE MAINTENANCE

No major pollution control device maintenance was performed during the three-month period prior to the test event.

5.6 RE-TEST DISCUSSION

Based on the results of this test program, a re-test is not immediately required. Subsequent emissions testing of the engine will be performed:

- Every 8,760 engine-operating hours or 3 years (2023), whichever is first, thereafter to evaluate compliance with NO_x, CO, and VOC emission limits in 40 CFR Part 60, Subpart JJJJ and the ROP. The service meter indicated 26 hours of operation at the conclusion of the compliance test.

5.7 RESULTS OF AUDIT SAMPLES

Audit samples for the reference methods utilized during this test program are not available from USEPA Stationary Source Audit Sample Program providers. The USEPA reference methods performed state reliable results are obtained by persons equipped with a thorough knowledge of the techniques associated with each method. Factors with the potential to cause measurement errors are minimized by implementing quality control (QC) and

assurance (QA) programs into the applicable components of field-testing. QA/QC components were included in this test program.

Table 5-1 summarizes the primary field quality assurance and quality control activities that were performed. Refer to Appendix D for supporting documentation.

**Table 5-1
QA/QC Procedures**

QA/QC Activity	Purpose	Procedure	Frequency	Acceptance Criteria
M1/M1A: Sampling Location	Evaluates if the sampling location is suitable for sampling	Measure distance from ports to downstream and upstream flow disturbances	Pre-test	≥2 diameters downstream; ≥0.5 diameter upstream.
M1/M1A: Duct diameter/ dimensions	Verifies area of stack is accurately measured	Review as-built drawings and field measurement	Pre-test	Field measurement agreement with as-built drawings
M3A, M7E, M10, M25A: Calibration gas standards	Ensures accurate calibration standards	Traceability protocol of calibration gases	Pre-test	Calibration gas uncertainty ≤2.0%
M3A, M7E, M10: Calibration Error	Evaluates operation of analyzers	Calibration gases introduced directly into analyzers	Pre-test	±2.0% of the calibration span or 0.5 ppmv or 0.5% CO ₂ absolute difference
M3A, M7E, M10: System Bias and Analyzer Drift	Evaluates analyzer and sample system integrity and accuracy over test duration	Calibration gases introduced at sample probe tip, heated sample line, and into analyzers	Pre-test and Post-test	±5.0% of the analyzer calibration span for bias and ±3.0% of analyzer calibration span for drift or ≤ 0.5 ppmv or 0.5% CO ₂ absolute difference
M7E: NO ₂ -NO converter efficiency	Evaluates operation of NO ₂ -NO converter	NO ₂ calibration gas introduced directly into analyzer	Pre-test or Post-test	NO _x response ≥90% of certified NO ₂ calibration gas introduced
M4 (ALT-008): Field balance calibration	Verify moisture measurement accuracy	Use Class 6 weight to check balance accuracy	Daily before use	Balance must measure weight within ±0.5 gram of certified mass
M25A/ALT-096: Calibration Error	Evaluates operation of analyzer and sample system	Calibration gases introduced through sample system	Pre-test	±5.0% of the calibration gas value
M25A/ALT-096: Zero and Calibration Drift	Evaluates analyzer and sample system integrity and accuracy over test duration	Calibration gases introduced through sample system	Pre-test and Post-test	±3.0% of the analyzer calibration span

5.8 CALIBRATION SHEETS

Calibration sheets, including gas protocol sheets and analyzer quality control and assurance checks are presented in Appendix D.

5.9 SAMPLE CALCULATIONS

Sample calculations and formulas used to compute emissions data are presented in Appendix A.

5.10 FIELD DATA SHEETS

Field data sheets are presented in Appendix B.

5.11 LABORATORY QUALITY ASSURANCE / QUALITY CONTROL PROCEDURES

The method specific quality assurance and quality control procedures in each method employed during this test program were followed, without deviation.

5.12 QA/QC BLANKS

The Method 3A, 7E, 10, and 25A calibration gases described in Table 5-1 above were the QA/QC media employed during the test event. QA/QC data are shown in Appendix D.